



THE UNIVERSITY *of* EDINBURGH

Edinburgh Research Explorer

A multi-objective approach for optimal prioritization of energy efficiency measures in buildings

Citation for published version:

Karmellos, M, Kiprakis, A & Mavrotas, G 2015, 'A multi-objective approach for optimal prioritization of energy efficiency measures in buildings: Model, software and case studies', *Applied Energy*, vol. 139, pp. 131-150. <https://doi.org/10.1016/j.apenergy.2014.11.023>

Digital Object Identifier (DOI):

[10.1016/j.apenergy.2014.11.023](https://doi.org/10.1016/j.apenergy.2014.11.023)

Link:

[Link to publication record in Edinburgh Research Explorer](#)

Document Version:

Peer reviewed version

Published In:

Applied Energy

General rights

Copyright for the publications made accessible via the Edinburgh Research Explorer is retained by the author(s) and / or other copyright owners and it is a condition of accessing these publications that users recognise and abide by the legal requirements associated with these rights.

Take down policy

The University of Edinburgh has made every reasonable effort to ensure that Edinburgh Research Explorer content complies with UK legislation. If you believe that the public display of this file breaches copyright please contact openaccess@ed.ac.uk providing details, and we will remove access to the work immediately and investigate your claim.



A multi-objective approach for optimal prioritization of energy efficiency measures in buildings: Model, software and case studies.

M. Karmellos^{a,b,*}, A. Kiprakis^a, G. Mavrotas^b

^a *Institute for Energy Systems, School of Engineering, University of Edinburgh, Edinburgh, EH93JL, UK*

^b *Laboratory of Industrial and Energy Economics, School of Chemical Engineering, National Technical University of Athens, Zographou Campus, 15780, Athens, Greece*

Abstract

Buildings are responsible for some 40% of the total final energy consumption in the European Union and about 40% of the world's primary energy consumption. Hence, the reduction of primary energy consumption is important for the overall energy chain. The scope of the current work is to assess the energy efficiency measures in the residential and small commercial sector and to develop a methodology and a software tool for their optimal prioritization.

The criteria used for the prioritization of energy efficiency measures in this article are the primary energy consumption and the initial investment cost. The developed methodology used is generic and could be implemented in the case of a new building or retrofitting an existing building. A multi-objective mixed-integer non-linear problem (MINLP) needs to be solved and the weighted sum method is used. Moreover, the novelty of this work is that a software tool has been developed using 'Matlab[®]' which is generic, very simple and time efficient and can be used by a Decision Maker (DM). Two case studies have been developed, one for a new building and one for retrofitting an existing one, in two cities with different climate characteristics. The building was placed in Edinburgh in the UK and Athens in Greece and the analysis showed that the primary energy consumption and the initial investment cost are inversely proportional.

* Corresponding Author
E-mail address: mkarmellos@chemeng.ntua.gr (M. Karmellos)

33 Keywords: Building energy efficiency, Energy efficiency measures, Multi-objective
34 optimization

35 **1 Introduction**

36

37 The increase of primary energy consumption and the climate change are amongst the biggest
38 challenges the 21st century faces. In most countries, governments have policies which aim to
39 reduce primary energy consumption by promoting energy efficiency. Specifically, the
40 building sector accounts for some 40% of the total final energy consumption in the European
41 Union and some 40% of the world's primary energy consumption [1], [2]. The European
42 Commission in order to rationalize the use of energy in buildings and increase energy
43 efficiency has issued the Energy Performance of Buildings (EPBD) Directive 2002/91/EC and
44 its recast 2010/31/EU regarding the European energy policy for the energy performance of
45 buildings and the rational use of energy [3], [4].

46

47 The reduction of energy consumption and especially primary energy consumption will
48 contribute to the reduction of energy in the total energy chain and increase sustainability in
49 buildings. Investing in energy efficiency is essential as the overall benefits will outweigh the
50 initial investment cost. The building sector is large, both in terms of energy consumption but
51 also in terms of number and type of buildings available. In general, there are two categories of
52 buildings, namely the existing buildings that might need retrofit actions and the new building
53 that are going to be built.

54

55 In order to reduce the primary energy consumption in buildings several efficiency measures
56 can be implemented. These measures can be divided into categories, such as those related to
57 the building envelope, the energy systems that provide heating, cooling and hot water, the
58 electrical appliances and the lighting systems and can be found analytically in [5]. Also, there
59 are energy systems that can provide electricity. Those can be cogeneration units or renewable
60 energy sources (RES) such as biomass, wind energy and solar energy. Energy efficiency
61 measures in each category have a different contribution to the reduction of the final and
62 primary energy consumption and also have an initial investment cost, typically higher than
63 conventional systems. Furthermore, the building's location plays an important role as the
64 climate and the available RES in an area might provide different solutions for each case.

65

66 Therefore, a Decision Maker (DM) needs to make a decision between many alternative
67 choices, which is usually not easy. The DM must take into account several criteria such as
68 financial or environmental in order to find the optimal solution according to his own
69 preferences. Although there are many approaches to tackle such problems, in this article a
70 multi-objective programming approach will be used. The first objective is to minimise the

71 primary energy consumption and the second objective is to minimise the initial investment
72 cost. A general rule followed states that if the initial investment cost is higher in components
73 with better energy behaviour, then the primary energy consumption will be lower resulting in
74 more energy savings. However, it is often the case that a DM does not have unlimited
75 resources, hence a compromise solution between these two criteria needs to be found. The
76 main concept of this approach is to allow the DM to propose the efficiency measures that he
77 is interested in, so as to allow him to find the optimal approaches for each category.

78

79 The paper is structured as follows: Section 2 provides a literature review of research on
80 energy efficiency measures in buildings. In Section 3 the proposed model is described.
81 Decision variables, constraints, parameters and objective functions are presented. Section 4
82 describes the multi-objective optimization approach used to solve the problem. Section 5
83 presents the developed software tool, which is explained in detail. In Section 6 the performed
84 case studies for a new building and an existing building under renovation are described and in
85 Section 7 the results are analysed. Section 8 concludes the paper. Moreover, in Appendix
86 “A” the equations of the model are shown analytically, in Appendix “B” the proposed
87 components for the buildings in the case studies are presented and finally, in Appendix “C”
88 the values of the decision variables for the performed case studies are presented in detail.

89

90 **2 Literature Review**

91

92 Calculating energy loads in building and assessing energy efficiency measures has been
93 researched extensively in the last years. In 2006 Chung *et al.* in [6] performed a study
94 regarding benchmarking energy efficiency in commercial buildings using multiple regression
95 analysis. In [7] Wang *et al.* reviewed the energy performance methods for existing buildings.
96 In their study they quantify energy usage and propose a framework for the categorization of
97 energy quantification methods for existing buildings. Energy quantification methods are
98 divided into three categories, namely the calculation-based, measurement-based and hybrid
99 quantification methods. Regarding calculation-based methods, are further divided into
100 dynamic methods (use of basic simulation or representative simulation tools) and steady-state
101 methods (e.g. forward modelling approach or inverse modelling approach). Typical steady-
102 state methods used for the calculation of thermal performance in buildings are the degree-day
103 (DD) method, bin method and equivalent full-load hour method. Measurement based methods
104 are further divided into energy bill-based methods and monitoring-based methods. Finally,
105 hybrid quantification methods consist of calibrated simulations and dynamic inverse models.
106 A method for assessing buildings’ energy efficiency using dynamic simulation and

107 experiments has been developed by Pisello et al. in [8]. They proposed a methodology for
108 analysing the thermal performance of buildings using non-dimensional indexes. Another
109 framework for characterizing energy efficiency measures has been developed by Trianni *et al.*
110 in [9], which is based on several attributes grouped into six categories, namely economic,
111 energy, environmental, production, implementation and interaction with other systems.

112

113 The problem of designing low energy buildings and prioritizing the energy efficiency
114 measures has been approached by many researchers throughout the years. There are many
115 methods that can be used in order for a DM to make the optimal choice regarding which
116 energy efficiency measures to choose. Kolokotsa *et al.* [10] analyse the decision support
117 methodologies that can be used regarding the energy efficiency and management in buildings.
118 The criteria that can be used in order to support a decision are divided in categories such as:
119 (a) energy related: primary or final energy consumption, the heating and cooling load,
120 electricity consumption, embodied energy; (b) cost related: direct cost, initial investment cost,
121 life cycle cost, net present value and internal return rate of the investment; (c) environmental
122 related: annual emissions and global warming potential, life cycle environmental potential;
123 (d) indoor quality related: indoor temperature and humidity, CO₂ concentration, ventilation
124 rate, daylight availability, noise levels and (e) other criteria such as construction duration,
125 security etc.

126

127 In [11] Evins performed a review of the computational optimization methods that are applied
128 to sustainable building design. His analysis shows that there is a growth in the use of
129 optimization in sustainable building design, and more particular in the use of multi-objective
130 optimization methods. The dominant optimization method is genetic algorithm. Most of the
131 studies performed have energy as an objective function, followed by construction cost.
132 Regarding area of building design, building envelope is the dominant one. Another review
133 about the simulation-based optimization methods applied to buildings performance was done
134 by Nguen *et al.* in [12] and revealed that the major drawbacks in these methods are the
135 complexity of the problems, the high computational cost, the uncertainty of the parameters
136 and the multi-objective design problems. Also, their results point out that the most used
137 software packages for building simulations are EnergyPlus and TRNSYS and the most used
138 optimization platforms are GenOpt and Matlab.

139

140 Mavrotas *et al.* in [13] studied energy planning in buildings taking into account the
141 uncertainty of fuel costs. They developed a linear programming model with fuzzy parameters
142 in order to deal with the uncertainties of fuel costs, which then is transformed into an

143 equivalent multi-objective problem. Their analysis is mainly applied to larger energy
144 consuming buildings where energy investment decisions may be affected significantly.

145

146 Wang *et al.* [14] in 2005 tried to use genetic algorithms in a multi-objective programming
147 approach for designing green buildings. Their approach was to minimise the life cycle cost
148 and the life cycle environmental impact, by taking into account the building's design
149 variables of the building's envelope. In their analysis they used genetic algorithms (GA) but
150 as those are random the resulted Pareto Front was considered to be the values of the external
151 population (final solutions). The study showed that optimal values for some variables change
152 between different Pareto zones. Also, it was shown that the utility structure affects the
153 environmental performance significantly.

154

155 Chlela *et al.* in [15] introduced a methodology regarding the design of new buildings based
156 on parametric analysis. This approach requires a design of experiments in order to perform a
157 statistical analysis on the selected variables, resulting in the modelling of the energy
158 consumption.

159

160 In 2008, Diakaki *et al.* [1] built a generic methodology based on multi-objective programming
161 approach, aiming to minimize the primary energy consumption and the initial cost of
162 acquisition of the materials. The proposed model was limited as the only decision variables
163 were the window types, the insulations materials and the thickness of the wall. Also, different
164 multi-objective optimization techniques have been investigated, such as compromise
165 programming with the Tchebyshev criterion, the global criterion method and the goal
166 programming method.

167

168 Moreover, Diakaki *et al.* in [16] further developed the proposed methodology in [1]. They
169 resulted in a more detailed methodology by taking into account all the decision variables
170 regarding the thermal envelope and the energy systems of the building (except those
171 producing electricity). The model was based on a multi-objective programming approach
172 regarding the prioritization of energy efficiency measures in a new building that will be
173 constructed. The decision criteria that were used were the minimization of the primary energy
174 consumption, the initial investment cost (cost of construction, acquisition and installation) and
175 the CO₂ emissions.

176

177 A different approach aiming to optimize the thermal comfort and the energy consumption in a
178 residential building has been presented by Magnier and Haghicat in [17]. They proposed an
179 efficient model where the decision variables are related to the thermostat settings, heating,

180 ventilation and air condition system (HVAC) and passive solar design. Their approach was
181 based on the usage of a multi-objective evolutionary genetic algorithm (NSGA-II) with a
182 simulation-based Artificial Neural Network (ANN) method.

183

184 Popescu *et al.* in [18] studied the impact of energy efficiency measures on the economic value
185 of buildings. They assessed investments in energy efficiency measures by measuring the
186 payback period of investments, which they claim depends on the energy savings and the
187 added value of the property. However, they recommend that this financial analysis should be
188 taken into account when there is reliable evidence to support that the real-estate market reacts
189 to energy performance of the buildings. In [19] Saari *et al.* investigated the financial viability
190 of energy efficiency measures in a new detached building in Finland. They studied the impact
191 on the construction costs and the financial viability of eight alternative design concepts.

192

193 Yao in [20] studied energy optimization of building design in apartment buildings. He
194 introduced EDH index, which measures the energy performance difference between housing
195 units in order to evaluate proposed measures in design options aiming to reach 50% energy
196 efficiency improvement. Kusiak *et al.* in [21] performed a study about modelling and
197 optimization HVAC energy consumption in a typical office building. They used eight data-
198 mining algorithms to evaluate energy consumption, control settings and a set of parameters
199 and they constructed four models of energy consumption. They used a single objective
200 approach that was solved by the particle swarm optimization algorithm.

201

202 Fesanghary *et al.* in [22] proposed a multi-objective optimization model based on harmony
203 search algorithm. The decision criteria in that methodology were the minimization of the life
204 cycle cost and the minimization of the carbon dioxide equivalent emissions of the building.

205

206 Asadi *et al.* in [23] used a multi-objective optimisation programming problem trying to
207 maximize the energy savings and to minimise the retrofit cost, after the refurbishment of a
208 semi-detached building in Portugal. However, despite the fact that their approach was based
209 on the Portuguese regulations of building design, it could be transferred and used for other
210 countries as well.

211

212 In [24] Chantrelle *et al.* developed a multi-criteria optimization tool (MultiOpt) for the
213 renovation of buildings. MultiOpt has a graphical user interface and has a set of four criteria,
214 namely energy consumption, thermal comfort, cost and environmental impact. It takes into
215 account parameters related to control strategies and building envelope. For the optimization
216 procedure genetic algorithm NSGA-II is used.

217

218 A more recent study was made by Malatji *et al.* in [25] using a multi-objective model aiming
219 to maximize the energy savings after retrofitting a building and minimise the payback period
220 of the investment. In this approach the energy savings were not calculated but were taken
221 from the manufacturers' data. They used compromise programming technique with two
222 objectives and a genetic algorithm was used to solve the problem. Also, a sensitivity analysis
223 was performed to investigate uncertainties in parameters such as auditing error of the
224 facilities, variability of electricity prices, wrong calculation of energy savings, increase of the
225 initial investment cost, and change of the interest or discount rate.

226

227 Moreover, Hamdy *et al.* in [26] presented an efficient and time-saving simulation-based
228 optimization method. Their methodology was referring to the nearly-zero-energy building and
229 cost-optimal solutions of a single-family building in Finland, following the EPBD recast of
230 2010 [4]. They tried to minimize the primary energy consumption and the difference of the
231 life-cycle cost between a design option and a reference design for the specific climate zone.

232

233 **3 Model Building**

234

235 Diakaki *et al.* in [16] developed a multi-objective decision model for the improvement of
236 energy efficiency in buildings. In the current work we expand the model presented in [16] by
237 taking into account the lighting systems, electrical appliances and RES. Also, it is further
238 expanded to include the case of retrofitting an existing building. Another difference between
239 our work and [16] is that all the decision variables are considered to be binary. In other words,
240 we assume predetermined discrete values for the continuous variables of the model in [16]
241 which is in most cases more realistic (e.g. the thickness of insulation has predetermined
242 values). In this way we obtain a discretization of the decision space which is appropriately
243 modelled using binary variables. The basic characteristics of the model are given briefly
244 below while the full model with all the equations is presented in Appendix "A".

245

246 **3.1 Decision variables**

247

248 The current approach consists of decision variables related to: (1) the building envelope; (2)
249 the building's energy system; (3) the lighting system and (4) the electrical appliances.
250 Regarding the building envelope we have decision variables for door type, window type, wall
251 type with different layers of materials of different type. In other words, each wall type
252 consists of a number of known layers. The materials of these layers have specific thermal

253 conductivity and thickness. The same holds for the decision variables expressing the ceiling
254 and the floor type.

255 The building's energy system related decision variables describe the following issues:

- 256 • Heating systems: Provide only heating and can be electrical or non-electrical systems
257 which are further categorized according to their input fuel;
- 258 • Cooling systems: Provide only cooling (in this approach only electrical systems are
259 assumed to be available)
- 260 • DHW systems: Provide only hot water. They can be electrical or non-electrical, which
261 are further categorized according to their input fuel;
- 262 • Heating – cooling systems: Provide both space heating and cooling (only electrical
263 systems are assumed to be available);
- 264 • Heating – DHW systems: Provide both space heating and DHW supply. They can be
265 electrical or non-electrical which are further categorized according to their input fuel;
- 266 • Solar collector systems: Supply DHW by utilizing solar energy;
- 267 • Electricity generation systems: Provide electricity using RES.

268

269 The lighting system and the electric appliances are described by appropriate binary decision
270 variables, each one expressing a specific type.

271

272 **3.2 Constraints**

273

274 The constraints of the problem are mainly the energy balances, which means the satisfaction
275 of the energy demand for heating, cooling, DHW, lighting and electricity supply. Moreover,
276 in order to satisfy the energy demand the appropriate equipment must be selected. Therefore,
277 there are constraints regarding the selection of one equipment to satisfy the energy demand
278 for the respective category. In addition, there are constraints where one piece of equipment is
279 selected in case the same equipment can be used for multiple purposes (e.g. a heat pump for
280 both heating and cooling). Regarding the investment cost, it is calculated depending the
281 selected equipment for each category. The constraints can be seen in detail in Section A.2 in
282 Appendix "A".

283

284 **3.3 Parameters**

285

286 The parameters of the model are in general meteorological data, technical coefficients,
287 demand data, efficiencies, standard dimensions and costs which are required in the model's
288 constraints and objective functions, and most of which need to be insert by the DM.

289

290 In order to calculate the energy demand air temperature, solar radiation, water temperature,
291 number of people leaving in the house and dimensions of the building envelope are necessary.
292 Also, for the calculation of primary energy consumption for lighting and electrical appliances,
293 the number and operational hours of lamps and appliances are required. More technical
294 parameters such as efficiency coefficients of the selected equipment and of the electricity grid
295 are also necessary for the calculations. Moreover, the cost of the components is required for
296 the calculation of the total investment cost. All the parameters are presented analytically in
297 Appendix “A”.

298

299 **3.4 Objective functions**

300

301 In this model there are two objective functions: (a) minimization of the total annual primary
302 energy consumption or maximization of total annual primary energy savings and (b) the
303 minimization of the total investment cost for the interventions:

304 $g_1(\mathbf{x})$: Total annual primary energy consumption or total annual primary energy savings.

305 $g_2(\mathbf{x})$: Total Investment Cost

306

307 The primary energy consumption is the sum of energy consumption for heating, cooling,
308 DHW, lighting and electrical appliances. In this work, heating and cooling loads are
309 calculated using the DD method (for more details see [7], [27]). For the case of retrofitting an
310 existing building the methodology is similar to that of a new building. However, in this case
311 the objectives would be to achieve maximum primary energy savings with minimal initial
312 investment cost. Therefore, the primary energy consumption of the existing building before
313 any retrofit action must be calculated. The objective functions are described in more detail in
314 Section A.3 of Appendix “A” for both cases, namely, the case of a new building and the case
315 of retrofitting an existing one.

316

317 **4 Multi-objective Optimization**

318

319 As the name suggests, multi-objective (or multi-criteria) optimization involves optimization
320 in the presence of more than one (usually conflicting) objective functions. Multi-objective
321 optimization problems arise in a variety of real word applications and the need for efficient
322 and reliable methods is increasing. The main difference between single and multi-objective
323 optimization is that in the case of latter, there is usually no single optimal solution, but a set of

324 equally good alternatives with different trade-offs, also known as Pareto-optimal (or non-
 325 dominated or efficient) solutions. In the absence of any other information, none of these
 326 solutions can be said to be better than the other. Usually a decision maker is needed to
 327 provide additional preference information and to identify the “most preferred” solution.
 328 Depending on the paradigm used, such knowledge may be introduced before, during or after
 329 the optimization process. Multi-objective optimization thus has to combine two aspects:
 330 optimization and decision support.

331

332 In our case the problems defined in Equation (A.100) and in Equation (A.102) is a multi-
 333 objective programming problem which fall into the category of mixed-integer non-linear
 334 programming problems (MINLP). For the solution of this kind of problems we will first
 335 calculate a representation of the Pareto set and then we will select the most preferred among
 336 the Pareto optimal solutions. For the calculation of adequate representations of the Pareto set
 337 a straightforward method is the weighting method [28]–[30].

338

339 Therefore, equation (A.100) is modified as follows:

$$340 \quad \min [u(g_1(\mathbf{x}), g_2(\mathbf{x}))] = p_1 \left(\frac{g_1(\mathbf{x}) - g_{1\min}}{g_{1\max} - g_{1\min}} \right) + p_2 \left(\frac{g_2(\mathbf{x}) - g_{2\min}}{g_{2\max} - g_{2\min}} \right) \quad (1)$$

341

Subject to

342

Constraints: (A.1) - (A.99)

343 Where,

344 \mathbf{x} : a vector with the decision variables.

345 $g_1(\mathbf{x})$: Total annual primary energy consumption

346 $g_2(\mathbf{x})$: Total investment cost

347 $g_{1\min}$ and $g_{2\min}$: are the values of the criteria of (A.100) when they are optimized
 348 independently.

349 p_1 and p_2 : weight coefficients that reflect the relative importance of the two criteria, allowing
 350 the DM to take into account his personal preferences. The following condition for the weights
 351 must hold:

$$352 \quad p_1 + p_2 = 1 \quad (2)$$

353

354 $g_{1\max}$ and $g_{2\max}$: are the “nadir” (=worst) values of the criteria of Equation (A.100) and they
 355 are obtained from the payoff table (minimization of g_1 provides $g_{2\max}$ and vice versa,
 356 minimization of g_2 provides $g_{1\max}$). The denominator ($g_{k\max} - g_{k\min}$) is necessary as range
 357 equalization factor in order to provide a normalization of the objective functions. In this way

358 the weight coefficients are more meaningful and they are not influenced by differences in the
359 objective functions' scale or by the range of the objective functions.

360

361 As we told, for multi-objective optimization problems there is not a single solution. Hence the
362 concept of Pareto optimality is used which is defined as a set of solutions that belong in a pre-
363 set classification of an optimal solution. The weighting method is a scalarization method
364 which combines the two functions in one, allowing a DM to express his preference a priori or
365 a posteriori and compromise between the two criteria [17]. If the weight coefficients are
366 greater than zero then Equation (1) is sufficient for Pareto optimality [31].

367

368 In the case of retrofitting an existing building where the first objective (g_1) is to maximize the
369 energy savings equation (A.102) is modified as follows:

$$370 \quad \min [u(g_1(\mathbf{x}), g_2(\mathbf{x}))] = p_1 \left(\frac{g_{1\max} - g_1(\mathbf{x})}{g_{1\max} - g_{1\min}} \right) + p_2 \left(\frac{g_2(\mathbf{x}) - g_{2\min}}{g_{2\max} - g_{2\min}} \right) \quad (3)$$

371

Subject to

372

Constraints: (A.1) - (A.99), (2)

373 Where,

374 $g_1(\mathbf{x})$: Total annual primary energy savings.

375 $g_2(\mathbf{x})$: Total investment cost.

376

377 **5 Software Tool**

378

379 The methodology described in Section 3 has been used to develop a software tool for the
380 optimal prioritization of energy efficiency measures for a new and an existing building. The
381 software tool has been developed using 'Matlab[®]' and 'Microsoft Excel[®]'. The novelty of this
382 software tool is that it has the advantage of being generic and not depending on the number of
383 components in a building (e.g. number of doors, number of windows, number of walls etc). A
384 'Microsoft Excel[®]' spreadsheet contains all the relevant data for the analysis, i.e. the climate
385 data, building's characteristics and the proposed energy efficient measures.

386

387 In this software tool the following assumptions have been made: (a) only four categories of
388 electrical appliances have been used, which are: a television, an electric cooker, a refrigerator
389 and a washing machine; (b) only three alternative choices can be proposed for each decision
390 variable, hence the total number of decision variables is sixty three (63) and (c) only the case

391 of solar PV has been examined in the category of RES systems that are used to provide
392 electricity.

393

394 It is noted that the electrical energy output of a photovoltaic system is equal to [32]:

$$395 \quad Q_{pv} = A_{pv} n_{pv} PR_{pv} F_{s,pv} I_{SL} \quad (4)$$

396 Where,

397 A_{pv} : the area of the photovoltaic array (m^2)

398 n_{pv} : efficiency of the panel (%)

399 PR: performance ratio expressing the losses of the system (circuit, battery, inverter) (%)

400 $F_{s,pv}$: shading factor (%)

401

402 In order to solve this multi-objective problem ‘BONMIN’ algorithm has been used which is
403 suitable for solving convex MINLP problems [33]. As ‘BONMIN’ is not implemented in
404 ‘Matlab[®]’ the ‘OPTI TOOLBOX’ has been used, which is an open-source software that can
405 be implemented in ‘Matlab[®]’ and has many optimization solvers available [34].

406

407 In order to use the software tool a DM must know how to use the necessary script files and
408 needs to have ‘Matlab[®]’ and the ‘OPTI TOOLBOX’ installed. The software tool can perform
409 all the necessary calculations and export the results in a ‘Microsoft Excel[®]’ file. The weight
410 factors pairs that are used are fixed and equal to: $p_1=1$ and $p_2=0$ to $p_1=0$ and $p_2=1$ with step
411 equal to 0.05. The reasons why the weight factors pairs are fixed a priori is to provide the full
412 Pareto front to a DM, allowing him to examine all the optimal solutions.

413

414 The results obtained by using the software tool are all the values of the minimization of
415 equation (1), the primary energy consumption, the initial investment cost and the values of the
416 decision variables for each working pair of weight coefficients. Moreover, for further
417 analysis, the software tool can be used to export the results of energy demand and primary
418 energy consumption of each category for each month by using the respected script file.

419

420 Similarly to the provided software tool for the case of a new building described in the
421 previous section, and based on the methodology described in Section 3 a software tool has
422 been developed for the optimal prioritization of energy efficiency measures for the case of
423 retrofitting an existing building.

424

425 Its features are similar to the software tool for the new building. Moreover, due to the
426 constraints described in A.3.2 (i.e. no proposed wall, floor or ceiling structures) the total

427 number of decision variables is reduced to fifty four (54). Instructions regarding the usage of
428 the software tool and the spreadsheet are available within.

429

430 An additional assumption for the case of retrofitting an existing building is that the DM is
431 interested to make changes in all the categories of energy efficiency measures. This means
432 that the software tool will provide solutions for each set of the proposed components. The
433 software tool can perform all the necessary calculations and it can export the results in a
434 ‘Microsoft Excel[®]’ file. The results obtained by using the software tool are all the values of
435 the minimization of equation (3), the maximization of the primary energy consumption
436 savings, the minimization of the initial investment cost and the values of the decision
437 variables for each working pair of weight coefficients. Moreover, for further analysis, the
438 software tool can be used to export the results of energy demand and primary energy
439 consumption of each category for each month before and after the retrofit actions.

440

441 Also, it is noted that in this software tool some variables are considered to be constant and are
442 presented in Table 1.

443

Parameters	Value [27]
ACH (h^{-1})	1.5
ρ_{air} (kg/m^3)	1.2
cp_{air} ($kJ/kg K$)	1.0035
P_{water} (kg/m^3)	1000
cp_{water} ($kJ/kg K$)	4.18
Q_{human} (W)	115

444

Table 1: Parameters with constant value used in this model

445

446 It is noted that this software tool is for academic use. It is not developed in an integrated
447 software platform, therefore the DM must have basic skills of Excel and Matlab. A flowchart
448 for the operation of software tool (which is similar in both the case of a new building and an
449 existing one) is presented in Figure 1.

450

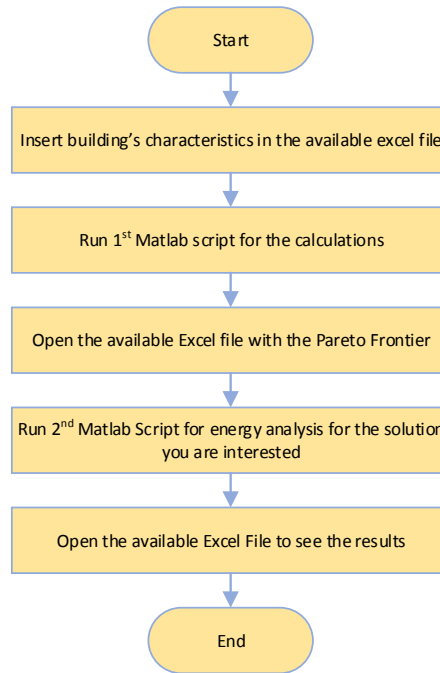


Figure 1: Flowchart for the use of software tool

451

452

453 6 Case Study

454

455 In order to evaluate the efficiency and the robustness of the proposed methodology and
456 software tools, two simulations on a typical detached UK house (see Figure 2) have been
457 carried out. The building's characteristics are presented in Table 2. The proposed energy
458 efficient components are presented in Appendix "B" in Table B.1 up to Table B.18. It is noted
459 that the tables with the proposed components consist also of the data for the existing
460 components of the building, which would be examined in the next section. The values
461 regarding the materials, their efficiency and their corresponding cost are from several sources
462 [5], [16], [27] and from an unofficial internet survey of several UK online retailers.

463

464 The building will be considered both as a new building and as an existing building under
465 retrofit actions. Moreover, for purposes of comparison the examined building will be placed
466 and simulated in two different locations where the climate characteristics are very different:
467 (a) Edinburgh in the UK and (b) Athens in Greece. The climate characteristics of Edinburgh
468 and Athens are presented in the Table 3. Also, the variables that the DM has to define and are
469 used for this analysis are presented in Table 4. Moreover, for reasons of simplicity it is
470 assumed that all the temperature correction factors and shading factors are considered to be
471 equal to 1. It is further assumed that the cost of the components is the same in both cities and
472 it will be expressed in Great British Pounds sterling (£).

473

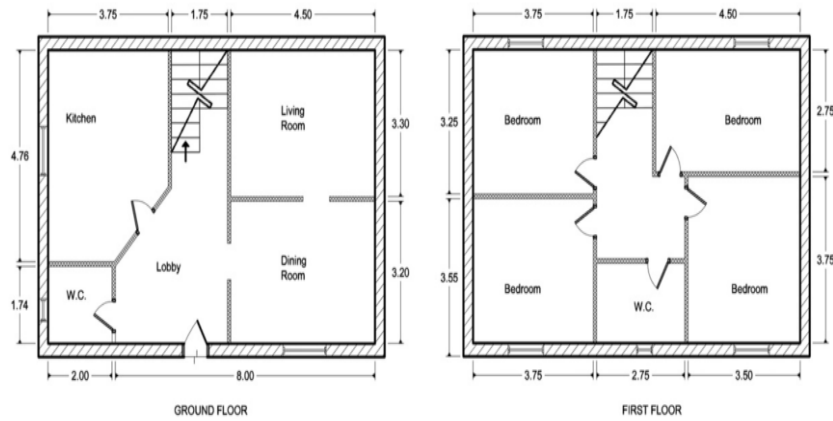


Figure 2: A typical detached house in the UK (source: [35])

474
 475
 476

Component	Value
External Wall (m ²)	194
Internal Wall (m ²)	99
First floor & ground floor ceiling(m ²)	62
Ground floor (m ²)	65
Roof (m ²)	75
First floor ceiling (m ²)	65
Windows (m ²)	13
External doors (m ²)	3
Internal Volume V (m ³) ^a	344

Table 2: Characteristics of the examined building (source: [35])

477
 478
 479
 480
 481

Note:

^a: it can be calculated from the building's characteristics after calculating the total volume and subtracting the volume occupied by interior walls

	Air Temperature (°C)		Daily Solar Radiation (kwh/m ² /day)		Water Temperature (°C)		Relative Humidity (%)	
	EDI ^a	ATH ^a	EDI ^{a,b}	ATH ^{a,b}	EDI ^c	ATH ^d	EDI ^a	ATH ^a
January	3.9	7.4	0.57	1.39	9	11.3	83.6%	69.5%
February	4.2	7.8	1.28	1.91	9	10.9	80.5%	64.4%
March	5.6	10.8	2.19	2.78	10	11.8	78.2%	56.7%
April	7.3	15.8	3.32	3.85	13	14.3	77.0%	47.4%
May	10.1	21.5	4.58	5.01	14	17.7	77.0%	39.9%
June	12.9	26.4	4.56	5.27	16	21.6	77.2%	34.5%
July	14.9	28.6	4.31	4.93	18	24.7	78.9%	33.9%
August	14.7	28.0	3.68	4.62	17	25.4	79.1%	36.5%
September	12.5	24.2	2.54	3.93	16	24.2	80.7%	41.6%
October	9.5	18.9	1.45	2.49	15	21.1	82.6%	51.5%
November	6.4	13.1	0.74	1.54	13	16.9	83.7%	63.7%
December	4.5	8.7	0.44	1.22	12	13.5	85.0%	71.2%

Table 3: Climate Characteristics of Edinburgh (EDI) and Athens (ATH)

482
 483
 484
 485
 486
 487
 488

Notes:

^a: source [36]

^b: Daily solar radiation is assumed to be falling at the optimal angle of the area and is calculated with the methodology described in [37]

^c: source [38]

^d: source [39]

489

Parameter	Value		Parameter	Value	
	EDI	ATH		EDI	ATH
T_{IH} (°C)	18 [32]	18 [39]	Number of People	4	4
T_{IC} (°C)	24 [32]	26 [39]	\dot{m}_w (l/day)	60 [5]	60 [5]
T_{DHW} (°C)	60 [32]	60 [32]	n_{grid} (%)	35 [16]	35 [16]
h_i (W/m ² K)	8.3 [27]	8.3 [27]			
h_o (W/m ² K)	28 [27]	28 [27]			

Table 4: Parameters used in the case studies that are set by the DM

490
491

492 7 Results

493

494 7.1 The Case of a New Building

495

496 The obtained results from the simulations are presented in Table 5. The values of the decision
 497 variables for each working pair of weight coefficients can be seen analytically in Appendix
 498 “C” from Table C.1 up to Table C.4. It is noted that the software tool took 4 and 4.1 minutes
 499 in a ‘Windows 8.1’ operating system, supported by a 3.07GHz i7 processor and 12GB RAM,
 500 to run the simulations for the case of Edinburgh and Athens respectively. This time includes
 501 the input of the necessary data, all the optimizations and the exportation of the results to the
 502 Excel spreadsheet file; hence it can be seen that the proposed method and software tool can be
 503 time efficient.

504

$\min[u(g_1(x), g_2(x))]$		P ₁	P ₂	Primary Energy Consumption (MJ/year)		Initial Investment Cost (£)	
EDI	ATH			EDI	ATH	EDI	ATH
0.000	0.000	1.00	0.00	58,499	59,147	53,006	52,031
0.028	0.019	0.95	0.05	58,684	59,274	41,260	40,485
0.054	0.042	0.90	0.10	58,684	59,526	41,260	38,815
0.079	0.064	0.85	0.15	58,857	59,526	40,860	38,815
0.104	0.084	0.80	0.20	59,382	59,976	40,042	37,797
0.119	0.103	0.75	0.25	63,705	59,976	34,642	37,797
0.128	0.123	0.70	0.30	63,705	59,976	34,642	37,797
0.137	0.142	0.65	0.35	63,705	60,199	34,642	37,597
0.145	0.161	0.60	0.40	63,705	60,199	34,642	37,597
0.154	0.159	0.55	0.45	63,705	65,542	34,642	33,867
0.163	0.166	0.50	0.50	63,778	65,542	34,613	33,867
0.171	0.166	0.45	0.55	63,778	69,768	34,613	32,197
0.180	0.165	0.40	0.60	63,778	70,003	34,613	32,126
0.184	0.164	0.35	0.65	68,799	70,342	33,483	32,071
0.178	0.162	0.30	0.70	85,765	70,342	30,562	32,071
0.162	0.148	0.25	0.75	85,765	79,158	30,562	30,469
0.135	0.126	0.20	0.80	99,117	90,519	29,020	29,020
0.106	0.100	0.15	0.85	102,030	90,519	28,809	29,020

$\min[u(g_1(x),g_2(x))]$		P_1	P_2	Primary Energy Consumption (MJ/year)		Initial Investment Cost (£)	
EDI	ATH			EDI	ATH	EDI	ATH
0.075	0.072	0.10	0.90	102,030	93,926	28,809	28,809
0.043	0.042	0.05	0.95	102,030	93,926	28,809	28,809
0.000	0.000	0.00	1.00	126,899	116,093	28,509	28,509

Table 5: Values of the primary energy consumption and initial investment cost for each working pair using for the case of a new building in Edinburgh (EDI) and Athens (ATH)

505
506
507

508 From Table C.1 up to Table C.4 it can be seen that when the primary energy consumption
 509 criterion is independently minimized the components which have the best energy behaviour
 510 are selected. This means the components of the building's envelope (doors, windows, wall
 511 structure, floors structure and ceilings structure) with the lowest U_{value} are selected, and the
 512 energy systems with the higher generation efficiency. For instance, it can be seen that the
 513 Door 2 has been selected, the window type 2 which is a low-e window and so forth. However,
 514 it is observed that there are differences at each city. In Athens the window 3 that has lower
 515 SHGC is selected for all the working pairs of weight coefficients. This happens as in Athens
 516 the solar radiation is higher than in Edinburgh which causes a significant increase in cooling
 517 demand. By contrast, in Edinburgh the window with the lowest U_{value} is most frequently
 518 selected (when the primary energy consumption criterion is more important) in order to
 519 minimize heating demand.

520


521 In the category of the building's energy systems, in both cities the heating-DHW system 3 is
 522 selected which is a highly efficient heat pump with a COP 4 and the electrical cooling system
 523 3 that has is an air-condition system with a COP 3. Also, the LED proposed lamps are chosen
 524 to provide lighting as they have the lowest power. The same applies for all the electrical
 525 appliances. In both cities solar collector 1 and photovoltaics 3 have been chosen as they can
 526 produce more hot water and electricity respectively.

527

528 On the other hand, when the cost criterion is minimized independently, the components with
 529 the lowest investment cost are selected. As shown in Table 5 the solution is the same for both
 530 cities. The building's envelopes components with the highest U_{value} and the energy systems
 531 with the lowest efficiency are selected. A low efficiency heating-cooling system has been
 532 selected and a low efficiency oil-based boiler to provide hot water. In addition, a fluorescent
 533 lamp and electrical appliances with the lowest cost that have the highest power have been
 534 selected.

535

536 The Pareto frontier that includes the values of primary energy consumption and total
537 investment cost for all the working weighting pairs is shown in Figure 3 and it represents all
538 the optimal solutions. It can be seen clearly that the initial investment cost and primary energy
539 consumption of a building are inversely proportional. The higher the total investment cost, the
540 lower the primary energy consumption. When the primary energy consumption criterion is
541 more important the components with the best energy behaviour are selected, but as the cost
542 criterion gets more important cheaper components are selected, which confirms the general
543 hypothesis and shows that the methodology and the developed software are robust. It is
544 suggested that the most preferred solutions for the DM are those indicated in the diagram of
545 the Pareto frontier, because for these cases a small reduction of the investment cost does not
546 increase primary energy consumption dramatically.
547

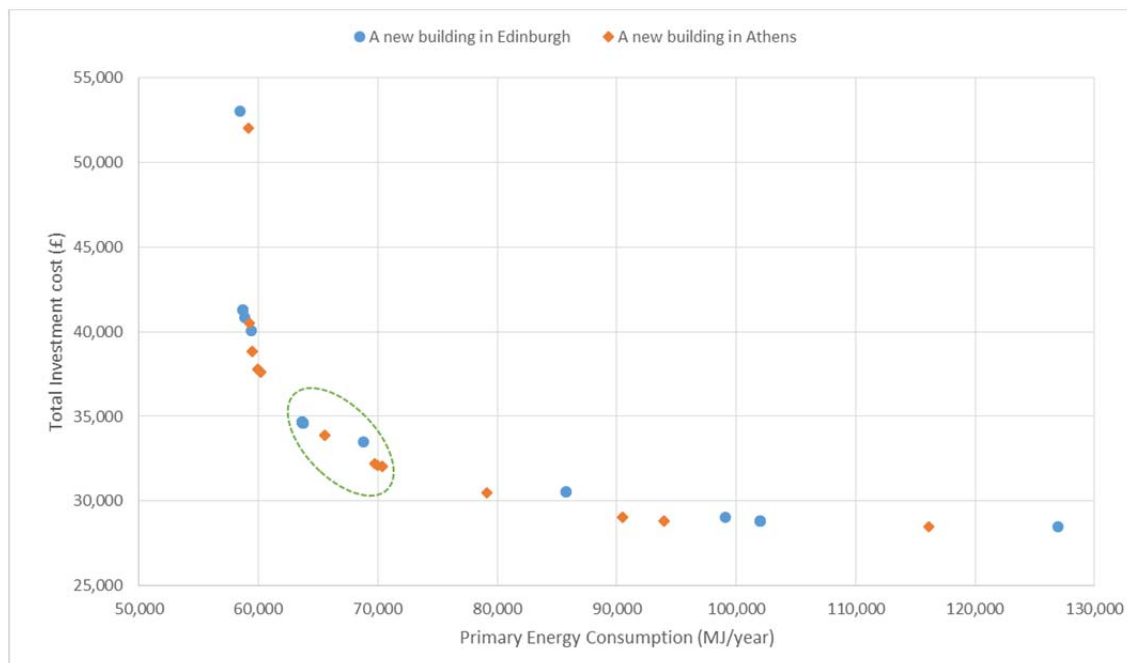

548

549 *Figure 3: The Pareto Frontier using the weighted sum method for the case study of a new building in*
550 *the cities of Edinburgh and Athens.*

551

552 The minimal and maximum total initial investment cost comes to £28,509 and £53,006
553 respectively in Edinburgh and £28,509 and £52,031 respectively in Athens. The minimal and
554 the maximum primary energy consumption in Edinburgh is 58,499 MJ/year and 126,899
555 MJ/year respectively; while the minimal and the maximum primary energy consumption in
556 Athens is 59,147 MJ/year and 116,093 MJ/year respectively. Furthermore, it can be noticed
557 that the primary energy consumption in Athens and Edinburgh is similar although the climate
558 characteristics are different, however there are major differences between the energy
559 categories.


560

561 The importance of the climate characteristics can be seen in more detail by comparing the
562 energy demand and primary energy consumption of the building in each city. In Figure 4 the
563 contribution of each energy category to the total annual energy demand is presented for the
564 case of weight coefficients $(p_1, p_2)=(0.35, 0.65)$. As previously mentioned, the DM can use
565 the software tool to obtain the energy demand and energy consumption analytically for any
566 working pair of weight coefficients, according to his own preferences. In this analysis, the
567 particular working pair of weight coefficients has been chosen because is in the area of the
568 most preferred optimal solutions.

569

570 It is shown that if the building is located in Edinburgh the heating energy demand is the
571 dominant category, whilst when the building is located in Athens the cooling energy demand
572 is higher because of the difference in Degree-days in the two cities. In Figure 5 the primary
573 energy consumption share of each category is presented. It is observed that in Edinburgh the
574 primary energy consumption for heating has the highest contribution to the total primary
575 energy, whilst in Athens the primary consumption for the electrical appliances is the highest.
576 The importance of the chosen components is significant as they can have a major impact on
577 primary energy consumption. For instance, although in Athens the DHW demand is lower
578 than in Edinburgh the primary consumption is higher due to the choice of a less efficient
579 component for the hot water.

580

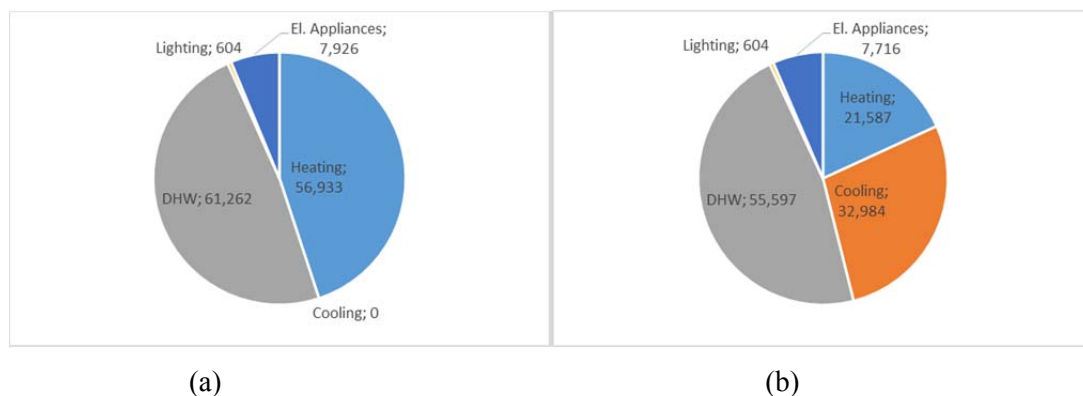

581

582

583 *Figure 4: Annual Energy Demand (MJ/year) for the case of a new building (a) Edinburgh and (b)*
584 *Athens, for the case of weight coefficients $(p_1, p_2)=(0.35, 0.65)$.*

585

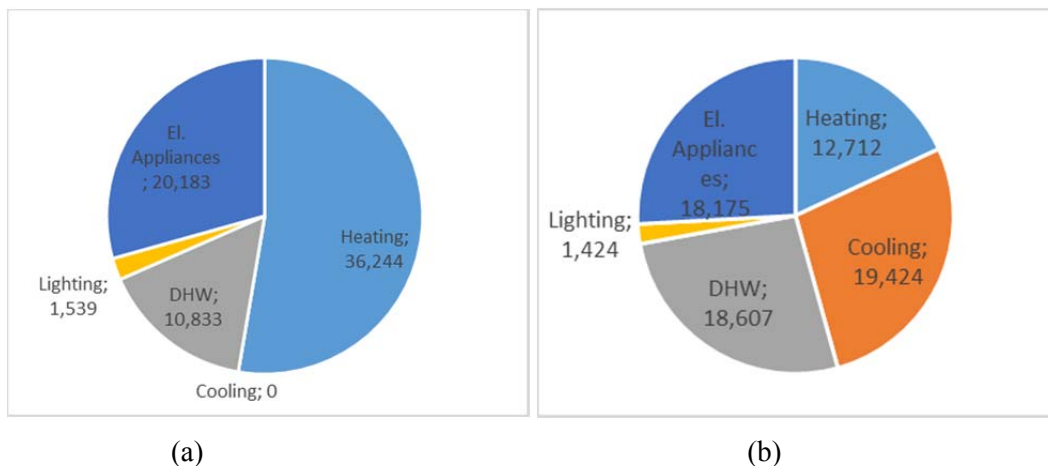


Figure 5: Annual Primary Energy Consumption (MJ/year) for the case of a new building in (a) Edinburgh and (b) Athens, for the case of weight coefficients $(p_1, p_2) = (0.35, 0.65)$.

Moreover, solar photovoltaics are chosen for both cities for this case. Electricity generation from RES is important as it can reduce the primary energy consumption significantly. The annual generation from PV in Athens is some 3,856 MJ/year while in Edinburgh is only 2,938 MJ/year which shows that Athens has much higher potential for utilizing solar energy.

7.2 The Case of Retrofitting an Existing Building

In this case, the examined building that has been used in the previous section is assumed to be an old existing building in the broader area of Edinburgh and Athens respectively. As mentioned before, the proposed components for each category and the components of the existing buildings are presented from Table B.1 up to Table B.18. It is noted that the existing building has low energy efficient components and is uninsulated.

Using the developed software tool for the case of retrofitting an existing building, the primary energy consumption of the existing building has first been calculated. The total annual primary energy consumption savings for the existing building when is located in Edinburgh and Athens is calculated to be 600,369 MJ/year and 290,801 MJ/year respectively.

The obtained results from the simulations are presented in Table 6. The values of the decision variables for each working pair calculated after the optimizations can be seen analytically in Appendix “C” in the Table C.5 up to the Table C.8. It is noted that the software tool took 4.9 and 4.2 minutes to run the simulations for the case of Edinburgh and Athens respectively. For comparison purposes with the case of a new building in Table 6 is also presented the primary energy consumption after the retrofit actions for the building placed in the city of Edinburgh and Athens respectively.

616

$\min[u(g_1(x),g_2(x))]$		P ₁	P ₂	Primary Energy Consumption Savings (MJ/year)		Primary Energy Consumption (MJ/year)		Initial Investment Cost (£)	
EDI	ATH			EDI	ATH	EDI	ATH	EDI	ATH
0.000	0.000	1.00	0.00	540,687	229,875	59,682	60,927	19,085	18,310
0.029	0.039	0.95	0.05	535,593	229,091	64,776	61,710	12,438	15,422
0.040	0.053	0.90	0.10	513,246	219,281	87,123	71,521	8,347	9,951
0.041	0.067	0.85	0.15	497,410	218,942	102,959	71,859	6,735	9,896
0.040	0.072	0.80	0.20	495,933	197,873	104,436	92,928	6,635	6,886
0.039	0.070	0.75	0.25	495,933	197,528	104,436	93,274	6,635	6,846
0.038	0.068	0.70	0.30	495,933	196,830	104,436	93,972	6,635	6,796
0.037	0.066	0.65	0.35	495,933	194,121	104,436	96,680	6,635	6,635
0.036	0.063	0.60	0.40	495,933	194,121	104,436	96,680	6,635	6,635
0.035	0.060	0.55	0.45	495,933	194,121	104,436	96,680	6,635	6,635
0.033	0.056	0.50	0.50	488,830	194,121	111,539	96,680	6,535	6,635
0.031	0.053	0.45	0.55	480,872	194,121	119,497	96,680	6,435	6,635
0.028	0.050	0.40	0.60	470,262	194,121	130,107	96,680	6,335	6,635
0.024	0.047	0.35	0.65	470,262	194,121	130,107	96,680	6,335	6,635
0.021	0.042	0.30	0.70	470,262	180,550	130,107	110,251	6,335	6,435
0.017	0.036	0.25	0.75	470,262	171,035	130,107	119,766	6,335	6,335
0.014	0.029	0.20	0.80	470,262	171,035	130,107	119,766	6,335	6,335
0.010	0.022	0.15	0.85	470,262	171,035	130,107	119,766	6,335	6,335
0.007	0.015	0.10	0.90	470,262	171,035	130,107	119,766	6,335	6,335
0.003	0.007	0.05	0.95	470,262	171,035	130,107	119,766	6,335	6,335
0.000	0.000	0.00	1.00	470,262	171,035	130,107	119,766	6,335	6,335

617 *Table 6: Values of the primary energy consumption savings and the initial investment cost for each*
 618 *working pair of weight coefficients for the case of retrofitting an existing building in Edinburgh (EDI)*
 619 *and Athens (ATH)*
 620

621 From Table C.5 up to the Table C.8 it is shown that when the primary energy consumption
 622 criterion is independently minimized the components with the best energy behaviour are
 623 selected, which is similar to the analysis presented in the previous chapter. In this case the
 624 initial investment cost is lower as the wall structure, floor structure and ceiling structure are
 625 not included in the retrofit actions. It is noted that the differences between Edinburgh and
 626 Athens that existed in the previous chapter still apply. For instance, when the energy criterion
 627 is independently minimized the components of the building envelope with the lowest U_{value}
 628 e.g. in Edinburgh the door number 2, window number 2, insulation material number 1 and so
 629 forth are selected, whilst in Athens window number 3 is again selected in all cases. The same
 630 energy systems as in the case of a new building have also been selected.

631

632 On the other hand, when the cost criterion is minimized independently, the components with
 633 the lowest initial investment cost are selected (e.g. door number 1, insulation number 3 etc.),
 634 and the energy systems that were chosen in the case of the new building, which are the same
 635 for both cities. Solar photovoltaics and solar collector systems are not selected for this case. It
 636 is observed that when the primary energy consumption savings criterion is more important the
 637 components with the best energy behaviour are selected, but as the cost criterion gets more

638 important the cheaper components are selected, which confirms the general hypothesis and
639 showing that the methodology and the developed software is robust. This means that the more
640 you invest in energy efficient measures the higher the energy savings are and the lower the
641 primary energy consumption becomes, which is similar to the case of a new building
642 presented in the previous section.

643

644 The minimal and the maximum total initial investment cost of the components is £6,335 and
645 £19,085 respectively in Edinburgh and £6,335 and £18,310 respectively in Athens. The
646 minimal and the maximum primary energy consumption savings in Edinburgh are 470,262
647 MJ/year (78%) and 540,687 MJ/year (90%) respectively which means that the primary energy
648 consumption is between 59,682 MJ/year to 130,107 MJ/year. In Athens the minimal and the
649 maximum primary energy consumption savings are 171,035 MJ/year (59%) and 229,875
650 MJ/year (79%) respectively, resulting in primary energy consumption between 60,927
651 MJ/year to 119,766 MJ/year. In the case of retrofitting an existing building the initial
652 investment cost is lower than the case of the new building presented in the previous chapter
653 because the wall structure, floor structure and ceiling structure are not included in the retrofit
654 actions.

655

656 The results for the other weight coefficients working pairs are in-between those values. The
657 Pareto frontier diagram shown in Figure 6 for the case of the retrofitting an existing building
658 in Edinburgh and Athens respectively represents all the optimal solutions. It can be indicated
659 that also in this case the initial investment cost and primary energy consumption of a building
660 are inversely proportional.

661


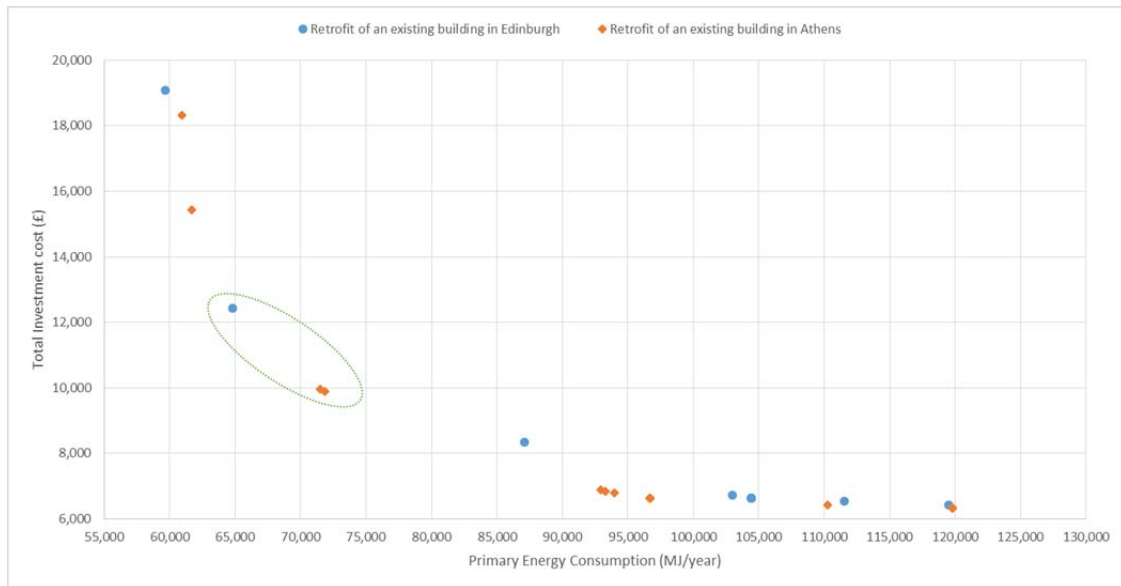


Figure 6: The Pareto Frontier using the weighted sum method for the case study of retrofitting an existing building in Edinburgh


662
 663
 664
 665
 666
 667
 668
 669
 670
 671
 672
 673
 674
 675
 676

The possibility of primary energy consumption savings is high in both cities but is greater in Edinburgh than in Athens due to the differences in climate characteristics. This is indicated with further analysis of the energy demand and of the primary energy consumption of each category. Figure 7 and Figure 8 present the energy demand and the primary energy consumption of the existing building before and after the retrofit actions in Edinburgh and Athens for the case of working weight coefficients $(p_1, p_2)=(0.95, 0.05)$ and $(p_1, p_2)=(0.85, 0.15)$ respectively. Those working pairs have been chosen as they belong in the area with the most preferred optimal solutions. It can be seen that when the best energy efficient measures are selected the energy demand is reduced significantly, resulting in high primary energy savings.

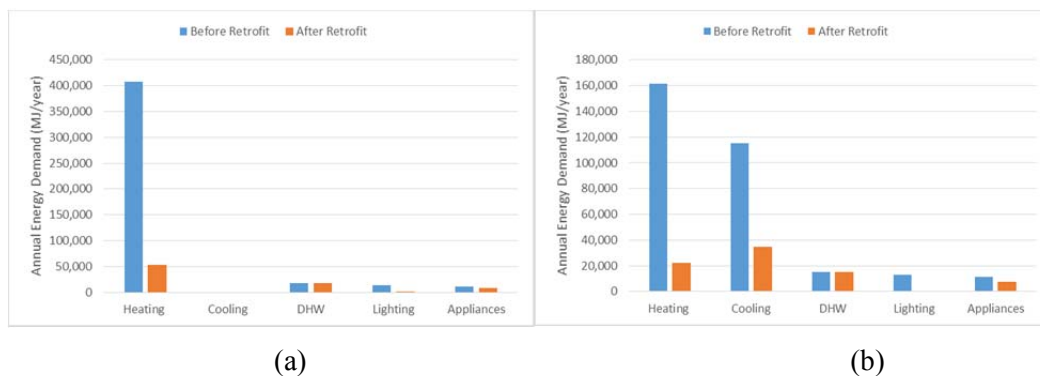

677
 678
 679
 680
 681

Figure 7: Annual Energy Demand before and after the retrofit for an existing building in (a) Edinburgh and (b) Athens, for the case of working weight coefficient $(p_1, p_2)=(0.55, 0.45)$

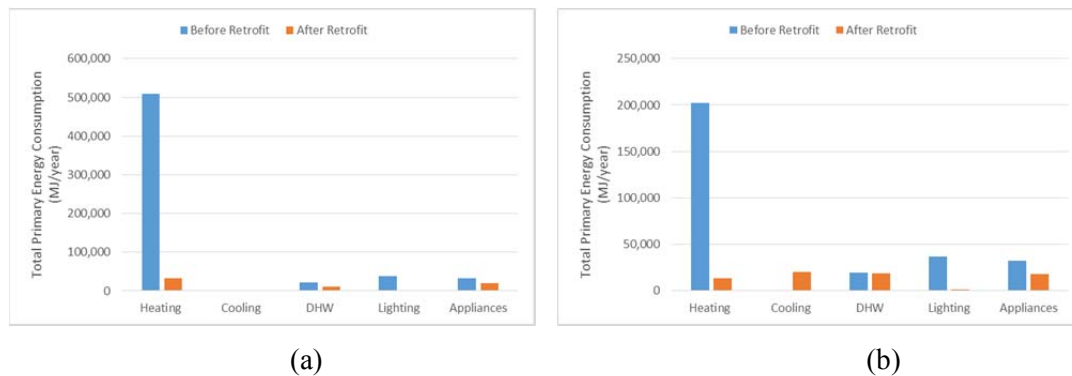

682
683
684
685
686
687

Figure 8: Annual primary energy consumption before and after the retrofit for an existing building in (a) Edinburgh and (b) Athens, for the case of working weight coefficient $(p_1, p_2) = (0.55, 0.45)$ and $(p_1, p_2) = (0.65, 0.35)$ for Edinburgh and Athens respectively

688 8 Conclusions

689

690 8.1 Main Findings

691

692 The minimization of energy demand and primary energy consumption in the building sector is
693 essential in order to reduce the energy consumption in the overall energy supply chain and
694 lead to sustainability in buildings. The reduction of primary energy in buildings will also
695 contribute in the achievement of the policy goals set by the UK Government and the
696 European Commission by the EPBD. Moreover, if less primary energy is used from fossil
697 fuels then the carbon dioxide emissions would also get reduced.

698

699 The scope of the present article is to expand a previously developed methodology to
700 optimally prioritize energy efficiency measures in terms of their energy behaviour and the
701 initial cost and also develop a software tool to be used by a DM. The methodology is generic
702 and can be used in order to optimally prioritize the energy efficiency measures for the case of
703 a new building and for the case of retrofitting an existing one. As described in Section 3, the
704 proposed methodology is depended on previous work with a more limited number of energy
705 efficiency measures and it was further expanded to take into account more categories of
706 energy efficiency measures, and also to analyse the case of retrofitting an existing building.
707 Many criteria exist to assess the energy efficiency measures but in the current article only the
708 primary energy consumption and the initial investment cost have been used, resulting in a
709 multi-objective optimisation problem.

710

711 Moreover, two software tools have been developed to allow the DM to propose energy
712 efficiency measures and prioritize them according to his own preferences, in the case of a new
713 building and of retrofitting an existing one. In order to solve the MINLP multi-objective

714 problem the weighted sum method has been used and the ‘bonmin’ algorithm has been
715 chosen. The software tools have been examined in two case studies, each for a new and
716 existing building, and they have been proven to be robust and time efficient. The analysis
717 showed that the more someone invests in energy efficiency the lower the primary energy
718 consumption becomes. Hence, a DM according to his own preferences can find the most
719 preferable solution from the provided Pareto front.

720

721 **8.2 Proposals for Future Work**

722

723 As previously mentioned, the two decision criteria used in this methodology are the primary
724 energy consumption and the initial investment cost. However, there are also many other
725 criteria that refer to energy efficiency measures (e.g. life cycle cost or operating cost). A DM
726 would probably be more interested in reducing the operating costs and his bills. Moreover,
727 environmental criteria could be also used such as the carbon dioxide emissions. As the
728 climate is one of the major challenges the planet faces a software tool that takes into account
729 the life cycle cost of the components and the carbon dioxide emissions or the global warming
730 potential might be preferable. It must be noted that our software tool could be expanded to
731 being capable of dealing with more than two objective functions (criteria).

732

733 Another constraint of the developed methodology is that it assumes that the loads are
734 constant, i.e. it is a steady-state approach. A methodology that would examine the energy
735 demand variations on a time basis would provide more accurate results but it would be more
736 difficult to solve. Also, the software tool can be further expanded to include wind energy or
737 CHP units and more categories of electrical appliances. Moreover, the software tool can be
738 further developed and become a software package in a more compact form that could be
739 executed independently without the need of a DM having ‘Matlab[®]’ installed.

740

741 **9 References**

742

743 [1] C. Diakaki, E. Grigoroudis, and D. Kolokotsa, “Towards a multi-objective
744 optimization approach for improving energy efficiency in buildings,” *Energy Build.*, vol. 40,
745 no. 9, pp. 1747–1754, Jan. 2008.

746 [2] J. Noailly, “Improving the energy efficiency of buildings: The impact of
747 environmental policy on technological innovation,” *Energy Econ.*, vol. 34, no. 3, pp. 795–
748 806, May 2012.

- 749 [3] *Directive 2002/91/EC of the European Parliament and of the Council*. European
750 Commission, 2002.
- 751 [4] *Directive 2010/31/EU of the European Parliament and of the Council*. European
752 Union.
- 753 [5] L. D. D. Harvey, *A Handbook on Low - Energy Buildings and District - Energy*
754 *Systems: Fundamentals, Techniques and Examples*. Earthscan, 2006.
- 755 [6] W. Chung, Y. V. Hui, and Y. M. Lam, “Benchmarking the energy efficiency of
756 commercial buildings,” *Appl. Energy*, vol. 83, no. 1, pp. 1–14, Jan. 2006.
- 757 [7] S. Wang, C. Yan, and F. Xiao, “Quantitative energy performance assessment methods
758 for existing buildings,” *Energy Build.*, vol. 55, pp. 873–888, Dec. 2012.
- 759 [8] A. L. Pisello, M. Goretti, and F. Cotana, “A method for assessing buildings’ energy
760 efficiency by dynamic simulation and experimental activity,” *Appl. Energy*, vol. 97, pp. 419–
761 429, Sep. 2012.
- 762 [9] A. Trianni, E. Cagno, and A. De Donatis, “A framework to characterize energy
763 efficiency measures,” *Appl. Energy*, vol. 118, pp. 207–220, Apr. 2014.
- 764 [10] D. Kolokotsa, C. Diakaki, E. Grigoroudis, G. Stavrakakis, and K. Kalaitzakis,
765 “Decision support methodologies on the energy efficiency and energy management in
766 buildings,” *Adv. Build. Energy Res.*, vol. 3, no. 1, pp. 121–146, Jan. 2009.
- 767 [11] R. Evins, “A review of computational optimisation methods applied to sustainable
768 building design,” *Renew. Sustain. Energy Rev.*, vol. 22, pp. 230–245, Jun. 2013.
- 769 [12] A.-T. Nguyen, S. Reiter, and P. Rigo, “A review on simulation-based optimization
770 methods applied to building performance analysis,” *Appl. Energy*, vol. 113, pp. 1043–1058,
771 Jan. 2014.
- 772 [13] G. Mavrotas, H. Demertzis, a. Meintani, and D. Diakoulaki, “Energy planning in
773 buildings under uncertainty in fuel costs: The case of a hotel unit in Greece,” *Energy Convers.*
774 *Manag.*, vol. 44, no. 8, pp. 1303–1321, May 2003.
- 775 [14] W. Wang, R. Zmeureanu, and H. Rivard, “Applying multi-objective genetic
776 algorithms in green building design optimization,” *Build. Environ.*, vol. 40, no. 11, pp. 1512–
777 1525, Nov. 2005.
- 778 [15] F. Chlela, A. Husaunndee, C. Inard, and P. Riederer, “A new methodology for the
779 design of low energy buildings,” *Energy Build.*, vol. 41, no. 9, pp. 982–990, Sep. 2009.
- 780 [16] C. Diakaki, E. Grigoroudis, N. Kabelis, D. Kolokotsa, K. Kalaitzakis, and G.
781 Stavrakakis, “A multi-objective decision model for the improvement of energy efficiency in
782 buildings,” *Energy*, vol. 35, no. 12, pp. 5483–5496, Dec. 2010.
- 783 [17] L. Magnier and F. Haghghat, “Multiobjective optimization of building design using
784 TRNSYS simulations, genetic algorithm, and Artificial Neural Network,” *Build. Environ.*,
785 vol. 45, no. 3, pp. 739–746, Mar. 2010.

- 786 [18] D. Popescu, S. Bienert, C. Schützenhofer, and R. Boazu, “Impact of energy efficiency
787 measures on the economic value of buildings,” *Appl. Energy*, vol. 89, no. 1, pp. 454–463, Jan.
788 2012.
- 789 [19] A. Saari, T. Kalamees, J. Jokisalo, R. Michelsson, K. Alanne, and J. Kurnitski,
790 “Financial viability of energy-efficiency measures in a new detached house design in
791 Finland,” *Appl. Energy*, vol. 92, pp. 76–83, Apr. 2012.
- 792 [20] J. Yao, “Energy optimization of building design for different housing units in
793 apartment buildings,” *Appl. Energy*, vol. 94, pp. 330–337, Jun. 2012.
- 794 [21] A. Kusiak, M. Li, and F. Tang, “Modeling and optimization of HVAC energy
795 consumption,” *Appl. Energy*, vol. 87, no. 10, pp. 3092–3102, Oct. 2010.
- 796 [22] M. Fesanghary, S. Asadi, and Z. W. Geem, “Design of low-emission and energy-
797 efficient residential buildings using a multi-objective optimization algorithm,” *Build.*
798 *Environ.*, vol. 49, pp. 245–250, Mar. 2012.
- 799 [23] E. Asadi, M. G. da Silva, C. H. Antunes, and L. Dias, “Multi-objective optimization
800 for building retrofit strategies: A model and an application,” *Energy Build.*, vol. 44, pp. 81–
801 87, Jan. 2012.
- 802 [24] F. P. Chantrelle, H. Lahmidi, W. Keilholz, M. El Mankibi, and P. Michel,
803 “Development of a multicriteria tool for optimizing the renovation of buildings,” *Appl.*
804 *Energy*, vol. 88, no. 4, pp. 1386–1394, Apr. 2011.
- 805 [25] E. M. Malatji, J. Zhang, and X. Xia, “A Multiple Objective Optimisation Model for
806 Building Energy Efficiency Investment Decision,” *Energy Build.*, vol. 61, pp. 81–87, Feb.
807 2013.
- 808 [26] M. Hamdy, A. Hasan, and K. Siren, “A multi-stage optimization method for cost-
809 optimal and nearly-zero-energy building solutions in line with the EPBD-recast 2010,”
810 *Energy Build.*, vol. 56, pp. 189–203, Jan. 2013.
- 811 [27] Y. A. Cengel and A. J. Ghajar, “Heating and Cooling of Buildings,” in *Heat and*
812 *Mass Transfer: Fundamentals and Applications*, McGraw-Hill, 2011.
- 813 [28] M. Zeleny, *Multiple Criteria Decision Making*. McGraw-Hill, 1982.
- 814 [29] R. E. Steuer, *Multiple Criteria Optimization-Theory, Computation and Application*,
815 2nd ed. Malabar FL: Krieger, 1989.
- 816 [30] K. M. Miettinen, *Nonlinear Multi-objective Optimization*. Boston: Kluwer Academic
817 Publishers, 1998.
- 818 [31] R. T. Marler and J. S. Arora, “Survey of multi-objective optimization methods for
819 engineering,” *Struct. Multidiscip. Optim.*, vol. 26, no. 6, pp. 369–395, Apr. 2004.
- 820 [32] J. J. L. Berben, I. Vis, K. Witchen, and K. Grau, “EPA - ED formulas: Calculation
821 Scheme: Energy Performance Assessment Method for Existing Dwellings,” 2004.

- 822 [33] P. Bonami, L. T. Biegler, A. R. Conn, G. Cornuéjols, I. E. Grossmann, C. D. Laird, J.
823 Lee, A. Lodi, F. Margot, N. Sawaya, and A. Wächter, “An algorithmic framework for convex
824 mixed integer nonlinear programs,” *Discret. Optim.*, vol. 5, no. 2, pp. 186–204, May 2008.
- 825 [34] J. Currie and D. Wilson, “OPTI: Lowering the Barrier Between Open Source
826 Optimizers and the Industrial MATLAB User,” in *Foundations of Computer-Aided Process
827 Operations*, 2012.
- 828 [35] R. M. Cuéllar-Franca and A. Azapagic, “Environmental impacts of the UK residential
829 sector: Life cycle assessment of houses,” *Build. Environ.*, vol. 54, pp. 86–99, Aug. 2012.
- 830 [36] Ministry of Natural Resources Canada, “RETScreen International Clean Energy
831 Project Analysis Software.” .
- 832 [37] S. Kalogirou, *Solar Energy Engineering : Processes and Systems*. Elsevier, 2009.
- 833 [38] Energy Saving Trust, “Measurement of Domestic Hot Water Consumption in
834 Dwellings,” 2008.
- 835 [39] Technical Chamber of Greece, “Technical Regulations 20701-3/2010 : Climate Data
836 of Greece [in greek],” 2010.
- 837 [40] C. Underwood and F. Yik, “Heat Transfer in Building Elements,” in *Modelling
838 Methods for Energy in Buildings*, Blackwell Publishing, pp. 1–46.
- 839

Nomenclature

Symbol	Description	Unit
ACH	Air changes per hour	h^{-1}
ASLC	Area of a solar collector	m^2
A_{win}	Area of a window	m^2
BLC	Building load factor	W/K
COSTCEIL	Initial investment cost for ceilings	£
COSTCS	Initial investment cost for a cooling system	£
COSTDOR	Initial investment cost for doors	£
COSTEA	Initial investment cost for electrical appliances	£
COSTFLO	Initial investment cost for floors	£
COSTHCS	Initial investment cost for a heating-cooling system	£
COSTHS	Initial investment cost for a heating system	£
COSTHWS	Initial investment cost for a heating-DHW system	£
COSTLIGHT	Initial investment cost for lamps	£
COSTRES	Initial investment cost for a RES power system	£
COSTSLC	Initial investment cost for a solar collector	£
COSTWAL	Initial investment cost for walls	£
COSTWIN	Initial investment cost for windows	£
$c_{p,\text{air}}$	Specific heat of air at constant pressure	kJ/kg/K
$c_{p,\text{wat}}$	Specific heat of water at constant pressure	kJ/kg/K
CS_m	Indicator for cooling demand each month	-
$F_{c,m,wn}$	Window correction factor for movable devices	%
$F_{F,wn}$	Frame factor of a window	%
f_{grid}	Percentage of electricity supply from the grid	%
F_s	shading factor of a solar collector	%
$F_{s,wn}$	Shading factor of a window	%
f_{use}	Factor indicating the usage of a device each day	h/day
h	Heat transfer convection coefficient	$\text{W/m}^2\text{K}$
h_i	indoors combined convection-radiation coefficient	$\text{W/m}^2\text{K}$
h_o	outdoors combined convection-radiation coefficient	$\text{W/m}^2\text{K}$
HS_m	Indicator for heating demand each month	-
I_{SL}	Solar radiation	$\text{kWh/m}^2/\text{day}$

Symbol	Description	Unit
k	Thermal conductivity	W/mK
l	Thickness of a material	M
\dot{m}_w	Daily need of hot water	L/day
$n_{ecsi,ecsj}^{ECS}$	Efficiency of an electric system $ecsj$ of category $ecsi$	%
$n_{ehsi,ehsj}^{EHS}$	Efficiency of an electric system $ehsj$ of category $ehsi$ for heating	%
$n_{ehcsi,ehcsj}^{EHCS}$	Efficiency of an electric system $ehcsj$ of category $ehcsi$ for heating-cooling	%
$n_{ehwsi,ehwsj}^{EHWS}$	Efficiency of an electric system $ehwj$ of category $ehwi$ used for heating- DHW	%
$n_{ewsi,ewsj}^{EWS}$	Efficiency of an electrical system ewj of category ewi for DHW	%
n_{grid}	Average efficiency of power generation of the grid	%
$n_{nehsi,nehsj}^{NEHS}$	Efficiency of a non-electric system $nehsj$ of category $nehsi$ used for heating	%
$n_{nehwsi,ehwsj}^{NEHWS}$	Efficiency of a non-electric system $nehwsj$ of category $nehwsi$ used for heating-DHW	%
$n_{newsi,ewsj}^{NEWS}$	Efficiency of a non-electric system $newsj$ of category $newsi$ used for DHW	%
$n_{slci,slcj}^{SLC}$	Efficiency of a non-electric system $nehwsj$ of category $nehwsi$ used for heating-DHW	%
n_{tot}	Total efficiency of a CHP unit	%
P_L	Power Rate of a Lamp	W
q''	Heat Flux	W/m ²
Q_C	Annual primary energy consumption for cooling	MJ/year
Q^{CD}	Annual cooling demand	MJ/year
Q_{el}^C	Annual primary energy consumption for cooling consumed by an electrical system	MJ/year
Q_{DHW}	Annual primary energy consumption for DHW	MJ/year
$Q_{dSLC,m}$	Energy provided by a solar collector for DHW	MJ/month
Q_{ea}	Heat emitted from appliances	W
Q^H	Annual primary energy consumption for heating	MJ/year
$Q_{nel,fuel}^H$	Annual primary energy consumption for heating from a non-electrical system using a specific fuel	MJ/year

Symbol	Description	Unit
Q_{el}^H	Annual primary energy consumption for heating from an electrical system	MJ/year
Q^{HD}	Annual heating energy demand	MJ/year
Q_{human}	Heat emitted from people	W
$Q_{INHG,m}$	Internal heat gain each month	kWh/month
Q_{lamp}	electricity consumption of a lamp	kWh/day
Q_L	Annual primary energy consumption for lighting	MJ/year
Q^{LD}	Annual energy demand for lighting	MJ/year
$Q_{SL,m}$	Solar heat gain each month	kWh/month
$Q_{T,m}$	Heat transmission losses each month	kWh/month
$Q_{ven,m}$	Ventilation losses each month	kWh/month
Q_{el}^W	Annual primary energy consumption of an electrical system for DHW	MJ/year
$Q_{nel,fuel}^W$	Annual primary energy consumption for DHW by a non-electrical system	MJ/year
Q^{WD}	Annual energy demand for DHW	MJ/year
T	Temperature	°C
t_d	Duration of a month in days	days/month
T_{DCW}	Temperature of cold water inlet to the DHW system	°C
T_{DHW}	Supply temperature of hot water by the DHW system	°C
T_{IH}	Internal design temperature for heating season	°C
t_L	Operation time of a lamp	h/day
t_m	Month duration in hours	h/month
$T_{o,m}$	Average air temperature of each month	°C
U	Overall heat transfer coefficient	W/m ² K
V	Internal volume of the building	m ³
WS_m	Indicator for DHW demand each month	binary
x_d^{DOOR}	Decision variable for doors	binary
$x_{eai,eaj}^{EA}$	Decision variable of electric appliance eaj of category eai	binary
$x_{ecsi,ecsj}^{ECS}$	Decision variable for an electrical cooling system $ecsj$ of categories $ecsi$	binary
$x_{ehsi,ehsj}^{EHS}$	Decision variable for an electrical heating system $ehsj$ of categories $ehsi$	binary
$x_{ehcsi,ehcsj}^{EHCS}$	Decision variable for an electrical heating-cooling system	binary

Symbol	Description	Unit
	<i>ehcsj</i> of category <i>ehcsi</i>	
$x_{ehwsi,ehwsj}^{EHWS}$	Decision variable for an electrical heating-DHW system <i>ehwsj</i> of category <i>ehwsi</i>	binary
x_h^{FLO}	Decision variable for floor structure <i>h</i>	binary
$x_{li,lj}^L$	Decision variable of lamp <i>lj</i> of category <i>li</i>	binary
$x_{nehsti,nehstj}^{NEHS}$	Decision variable for a non-electrical heating system <i>nehstj</i> of categories <i>nehsti</i>	binary
$x_{nehwsi,nehwsj}^{NEHWS}$	Decision variable for a non-electrical heating-DHW system <i>nehwsj</i> of category <i>nehwsi</i>	binary
x_r^{CEIL}	Decision variable for ceiling structure <i>r</i>	binary
$x_{resi,resj}^{RES}$	Decision variable for a RES energy system <i>resj</i> of category <i>resi</i>	binary
$x_{slci,slcj}^{SLC}$	Decision variable for a solar collector system <i>slcj</i> of category <i>slci</i>	binary
x_{zt}^{WIN}	Decision variable for windows type <i>z</i>	binary
x_w^{WALL}	Decision variable for wall structure <i>w</i>	binary
ρ_{air}	Air density	kg/m ³
ρ_{wat}	Water density	kg/m ³

Appendix “A”: Equations of the model

A.1 Decision Variables

A.1.1 Building Envelope

a. Doors

Let D be the available number of alternative type of doors. A decision variable x_d^{DOOR} where, $d = 1, \dots, D$, is defined such as:

$$x_d^{DOOR} = \begin{cases} 1, & \text{if door type } d \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.1})$$

It is assumed that the available proposed doors are of the same type and only one can be selected, which leads to the following constraint:

$$\sum_{d=1}^D x_d^{DOOR} = 1 \quad (\text{A.2})$$

b. Windows

Let Z be the available number of alternative type of windows (e.g. double glaze, low-e) where each consists of T_z sub-types (e.g. xenon-filled, vacuum-filled). A decision variable x_{zt}^{WIN} where $z = 1, \dots, Z$ and $t = 1, \dots, T_z$ is defined such as:

$$x_{zt}^{WIN} = \begin{cases} 1, & \text{if window sub-type } t \text{ of type } z \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.3})$$

It is assumed that the available window types are of the same type and only one may be selected, which leads to the following constraint:

$$\sum_{z=1}^Z \sum_{t=1}^{T_z} x_{zt}^{WIN} = 1 \quad (\text{A.4})$$

c. Walls

Let W be the available number of alternative types of structures of wall structures. A decision variable x_w^{WALL} where $w = 1, \dots, W$ is defined such as:

$$x_w^{WALL} = \begin{cases} 1, & \text{if wall structure } w \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.5})$$

It is assumed that from the available wall structures only one may be selected, which leads to the following constraint:

$$\sum_{w=1}^W x_w^{WALL} = 1 \quad (\text{A.6})$$

Furthermore, each wall structure consists of NWL_w number of known layers (with $nwl = 1, \dots, NWL_w$). The materials of these layers have specific thermal conductivities $kk_{w,nwl}^{WALL}$ ($W/m K$) and thicknesses $l_{w,nwl}^{WALL}$ (m).

Also let Y_w (with $y = 1, \dots, Y_w$) be the number of unknown layers (e.g. insulation) layer where their materials have to be chosen between the available ones. For each unknown layer y of structure w there are P_{wy} (with $p = 1, \dots, P_{wy}$) alternative materials available and only one is allowed to be chosen for the respected structure. Therefore, the following decision variable and constraint are defined:

$$x_{wyp}^{mWALL} = \begin{cases} 1, & \text{if material } p \text{ is selected for layer } y \text{ of wall structure } w \\ 0, & \text{else} \end{cases} \quad (\text{A.7})$$

$$\sum_{p=1}^{P_{wy}} x_{wyp}^{mWALL} = x_w^{WALL} \quad \forall (y = 1, \dots, Y_w \quad \forall w = 1, \dots, W) \quad (\text{A.8})$$

The thickness of the unknown layers of materials Y_w is considered to be predefined. Also, each of material c of layer y of wall structure w has kk_{wyc}^{mWALL} ($W/m K$) thermal conductivity and l_{wyc}^{WALL} thickness.

d. Ceilings

Similarly to walls, let R be the number of available alternative structures of ceilings. A binary decision available x_r^{CEIL} where $r = 1, \dots, R$ is defined such as:

$$x_r^{CEIL} = \begin{cases} 1, & \text{if ceiling structure } r \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.9})$$

Also, it is assumed that only one ceiling structure may be selected from all the proposed ceiling structures, which leads to the following constraint:

$$\sum_{r=1}^R x_r^{CEIL} = 1 \quad (A.10)$$

Also, let NCL_r be the number of the known layers of the ceiling structure r with $ncl = 1, \dots, NCL_r$). The materials of these layers have specific thermal conductivities $kk_{r,ncl}^{LCEIL}$ ($W/m K$) and thicknesses $l_{r,ncl}^{LCEIL}$ (m) which are already known.

Also there is a number F_r (with $f = 1, \dots, F_r$) of unknown layers where their materials have to be chosen between the available ones. For each unknown layer f of structure r there are A_{rf} (with $a = 1, \dots, A_{rf}$) alternative materials available and one can be selected for the chosen structure. Therefore, the following decision variable and constraint are defined:

$$x_{rfa}^{mCEIL} = \begin{cases} 1, & \text{if material } \alpha \text{ is selected for layer } f \text{ of ceiling structure } r \\ 0, & \text{else} \end{cases} \quad (A.11)$$

$$\sum_{a=1}^{A_{rf}} x_{rfa}^{mCEIL} = x_r^{CEIL} \quad \forall (f = 1, \dots, F_r \quad \forall r = 1, \dots, R) \quad (A.12)$$

The thickness of the unknown layers of materials F_r is considered to be predefined Also, each of material a of layer f of ceiling structure r has k_{rfa}^{mCEIL} ($W/m K$) thermal conductivity and l_{dfa}^{mCEIL} thickness.

e. Floors

Similarly to the approach for walls and ceilings, let H be the number of available alternative structures of floors, which leads to the decision variable x_h^{FLO} where $h = 1, \dots, H$ is defined as:

$$x_h^{FLO} = \begin{cases} 1, & \text{if floor structure } h \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (A.13)$$

Also, it is assumed that only one floor structure may be selected from all the proposed floor structures, leading to the following constraint:

$$\sum_{h=1}^H x_h^{FLO} = 1 \quad (\text{A.14})$$

Each floor structure h consists of NFL_h layers (with $nfl = 1, \dots, NFL_h$). The materials of these layers have specific thermal conductivities $kk_{h,nfl}^{FLO}$ ($W/m K$) and thicknesses $l_{h,nfl}^{FLO}$ (m) are already known.

Also there is a number E_h (with $e = 1, \dots, E_h$) of unknown layers where their materials have to be chosen between the available ones. For each unknown layer e of structure h there are G_{he} alternative materials available and one can be selected for the chosen structure. Therefore, the following decision variable and constraint are defined:

$$x_{heg}^{mFLO} = \begin{cases} 1, & \text{if material } g \text{ is selected for layer } e \text{ of floor structure } h \\ 0, & \text{else} \end{cases} \quad (\text{A.15})$$

$$\sum_{g=1}^{G_{he}} x_{heg}^{mFLO} = x_h^{FLO} \quad \forall (e = 1, \dots, E_h \quad \forall h = 1, \dots, H) \quad (\text{A.16})$$

The thickness of the unknown layers of materials E_h is considered to be predefined. Also, each of material g of layer e of floor structure h has kk_{heg}^{mFLO} ($W/m K$) thermal conductivity and l_{heg}^{mFLO} thickness.

A.1.2 Building's energy systems

The energy systems categories that are assumed to be available in this methodology are:

- Heating systems: Provide only heating and can be electrical or non-electrical systems which are further categorized according to their input fuel;
- Cooling systems: Provide only cooling (in this approach only electrical systems are assumed to be available)
- DHW systems: Provide only hot water. They can be electrical or non-electrical, which are further categorized according to their input fuel;
- Heating – cooling systems: Provide both space heating and cooling (only electrical systems are assumed to be available);
- Heating – DHW systems: Provide both space heating and DHW supply. They can be electrical or non-electrical which are further categorized according to their input fuel;
- Solar collector systems: Supply DHW by utilizing solar energy;

- Electricity generation systems: Provide electricity using RES.

The decision variables regarding the above systems are defined as follows:

Let $EHSI$ be the available categories of electrical heating systems which include $EHSJ_{ehi}$ systems, and let $NEHSI$ be the available categories of non-electrical heating systems including $NEHSJ_{nehsi}$ different systems, where $ehsi = 1, \dots, EHSI$, $ehsj = 1, \dots, EHSJ_{ehsi}$, $nehsi = 1, \dots, NEHSI$, $nehsj = 1, \dots, NEHS_{nehsi}$. Then the binary decision variables defined are:

$$x_{ehsi, ehsj}^{EHS} = \begin{cases} 1, & \text{if an electrical heating system } ehsj \text{ of category } ehsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.17})$$

$$x_{nehsi, nehsj}^{NEHS} = \begin{cases} 1, & \text{if a non-electrical heating system } nehsj \text{ of category } nehsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.18})$$

- Let $ECSI$ be the available categories of electrical cooling systems which include $ECSJ_{ecsi}$ systems where $ecsi = 1, \dots, ECSI$ and $ecsj = 1, \dots, ECSJ_{ecsi}$:

$$x_{ecsi, ecsj}^{ECS} = \begin{cases} 1, & \text{if an electrical cooling system } ecsj \text{ of category } ecsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.19})$$

- Let $EWSI$ be the available categories of electrical DHW systems categories which includes $EWSJ_{ewsi}$ systems and the let $NEWSI$ be the available categories of non-electrical DHW systems consisting of $NEWSJ_{newsi}$ different systems, where $ewsi = 1, \dots, EWSI$, $ewsj = 1, \dots, EWSJ_{ewsi}$, $newsi = 1, \dots, NEWSI$ and $newsj = 1, \dots, NEWSJ_{newsi}$:

$$x_{ewsi, ewsj}^{EWS} = \begin{cases} 1, & \text{if a DHW system } ewsj \text{ of category } ewsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.20})$$

$$(\text{A.21})$$

$$x_{newsi, newsj}^{NEWS} = \begin{cases} 1, & \text{if a non-electrical DHW system } newsj \\ \text{of category } newsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.22})$$

- Let $EHCSI$ be the available categories of electrical heating - cooling systems consisting of $EHCSJ_{ehcsi}$ systems, where $ehcsi = 1, \dots, EHCSI$ and $ehcsj = 1, \dots, EHCSJ_{ehcsi}$:

$$x_{ehcsi, ehcsj}^{EHCS} = \begin{cases} 1, & \text{if an electrical heating-cooling system } ehcsj \text{ of category } ehcsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.23})$$

- Let $EHWSI$ be the available categories of electrical heating – DHW systems consisting of $EHWSJ_{ehwsi}$ systems and let $NEHWSI$ be the available categories of non-electrical heating–DHW systems consisting of $NEHWSJ_{nehwsi}$ different systems, where $ehwsi = 1, \dots, EHWSI$, $ehwsj = 1, \dots, EHWSJ_{ehwsi}$, $nehwsi = 1, \dots, NEHWSI$ and $nehwsj = 1, \dots, NEHWSJ_{nehwsi}$:

$$x_{ehwsi, ehwsj}^{EHWS} = \begin{cases} 1, & \text{if an electrical heating – DHW system } ehwsj \\ & \text{of category } ehwsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.24})$$

$$x_{nehwsi, nehwsj}^{NEHWS} = \begin{cases} 1, & \text{if a non-electrical heating – DHW system } \\ & nehwsj \text{ of category } nehwsi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.25})$$

- Let $SLCI$ be the available categories of solar collector systems consisting of $SLCJ$ different systems, where $slci = 1, \dots, SLCI$ and $slcj = 1, \dots, SLCJ$:

$$x_{slci, slcj}^{SLC} = \begin{cases} 1, & \text{if solar collector } slcj \text{ of category } slci \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.26})$$

- Let $RESI$ be the available categories of RES electricity generation systems consisting of $RESJ_{resi}$ different systems, where $resi = 1, \dots, RESI$ and $resj = 1, \dots, RESJ_{resi}$:

$$x_{resi, resj}^{RES} = \begin{cases} 1, & \text{if RES power generation system } \\ & resj \text{ of category } resi \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (\text{A.27})$$

Some of the systems described above could belong into more than one categories. Therefore, some additional constraints are required in order to allow for the selection of only *one* system for each purpose:

- Space heating system amongst those available:

$$\begin{aligned} & \sum_{ehsi=1}^{EHSI} \sum_{ehsj=1}^{EHSJ_{ehi}} x_{ehsi,ehsj}^{EHS} + \sum_{nehsi=1}^{NEHSI} \sum_{nehsj=1}^{NEHSJ_{ehi}} x_{nehsi,nehsj}^{NEHS} + \sum_{ehcsi=1}^{EHCSI} \sum_{ehcsj=1}^{EHCSJ_{ehci}} x_{ehcsi,ehcsj}^{EHCS} \\ & + \sum_{ehwsi=1}^{EHWSI} \sum_{ehwsj=1}^{EHWSJ_{ehwsi}} x_{ehwsi,ehwsj}^{EHWS} + \sum_{nehwsi=1}^{NEHWSI} \sum_{nehwsj=1}^{NEHWSJ_{ehwsi}} x_{nehwsi,nehwsj}^{NEHWS} = 1 \end{aligned} \quad (A.28)$$

- Space cooling system amongst those available:

$$\sum_{ecsi=1}^{ECSI} \sum_{ecsj=1}^{ECJ_{ecsi}} x_{ecsi,ecsj}^{ECS} + \sum_{ehcsi=1}^{EHCSI} \sum_{ehcsj=1}^{EHCSJ_{ehci}} x_{ehcsi,ehcsj}^{EHCS} = 1 \quad (A.29)$$

- DHW system amongst those available:

$$\begin{aligned} & \sum_{ewsi=1}^{EWSI} \sum_{ewsj=1}^{EWSJ_{ewi}} x_{ewsi,ewsj}^{EWS} + \sum_{newsi=1}^{NEWSI} \sum_{newsj=1}^{NEWSJ_{ehsi}} x_{newsi,newsj}^{NEW} + \sum_{ehwsi=1}^{EHWSI} \sum_{ehwsj=1}^{EHWSJ_{ehwsi}} x_{ehwsi,ehwsj}^{EHWS} \\ & + \sum_{nehwsi=1}^{NEHWSI} \sum_{nehwsj=1}^{NEHWSJ_{ehwsi}} x_{nehwsi,nehwsj}^{NEHWS} = 1 \end{aligned} \quad (A.30)$$

- Solar collector system to provide DHW amongst those available if would be beneficial to choose one:

$$\sum_{slci=1}^{SLCI} \sum_{slcj=1}^{SLCJ} x_{slci,slcj}^{SLC} \leq 1 \quad (A.31)$$

- RES electricity system amongst those available if one would be beneficial. It is noted that it is assumed that the building would be connected to the grid:

$$\sum_{resi=1}^{RESI} \sum_{resj=1}^{RESJ_{ehci}} x_{resi,resj}^{RES} \leq 1 \quad (A.32)$$

A.1.3 Lighting systems

Let LI be the number of available categories of lighting systems, consisting of LJ_{li} types of lamps. Then the decision variable $x_{li,lj}^L$, where $li = 1, \dots, LI$ and $lj = 1, \dots, LJ_{li}$ is defined such as:

$$x_{li,lj}^L = \begin{cases} 1, & \text{if lamp type } lj \text{ of category } li \text{ is selected} \\ 0, & \text{else} \end{cases} \quad (A.33)$$

Assuming that from the available lamps only one can be selected the following constraint is defined:

$$\sum_{li=1}^{LI} \sum_{lj=1}^{LJ_{li}} x_{li, lj}^L = 1 \quad (\text{A.34})$$

A.1.4 Electrical appliances

Let EAI be the number of available categories electrical appliances consisting EAJ types of appliances available. Then the decision variable $x_{eai, eaj}^{EA}$, where $eai = 1, \dots, EAI$ and $eaj = 1, \dots, EAJ_{eai}$, is defined such as :

$$x_{eai, eaj}^{EA} = \begin{cases} 1, & \text{if the electric appliance } eaj \text{ is selected of category } eai \\ 0, & \text{else} \end{cases} \quad (\text{A.35})$$

Assuming that from the available electrical appliances only one can be selected for each category the following constraints are defined:

$$\sum_{eaj=1}^{EAJ_{eai}} x_{eai, eaj}^{EA} = 1 \quad (\text{A.36})$$

$$\sum_{eai=1}^{EAI} \sum_{eaj=1}^{EAJ_{eai}} x_{eai, eaj}^{EA} = EAI, \quad \forall (eaj = 1, \dots, EAJ_{eai} \quad \forall eai = 1, \dots, EAI) \quad (\text{A.37})$$

A.2 Constraints

A.2.1 Primary Energy consumption

The total annual primary energy consumption in a building is the primary energy used for heating, cooling, DHW, lighting and electrical appliances [32]:

$$Q_T = Q_H + Q_C + Q_{DHW} + Q_L + Q_A \quad (\text{A.38})$$

A.2.1.1 Primary Energy Consumption for Heating

Annually, the total annual primary energy consumption for heating would be equal to:

$$Q_H = \frac{Q_{el}^H f^{grid}}{n_{grid}} + \sum_{fuel=1}^{FUEL} Q_{nel,fuel}^H \quad (A.39)$$

where:

Q_{el}^H : Energy consumed by an electrical system for heating purposes (MJ/year)

f^{grid} : Percentage of electricity supply from the grid (RES electricity supply does not contribute to primary energy consumption).

n_{el} : The average efficiency for the electricity supply from the grid to the building (it is assumed to be 0.35 [16])

$Q_{nel,fuel}^H$: Energy consumed by a non-electrical system using a $fuel$ (where $fuel = 1, \dots, FUEL$) (MJ/year)

The energy consumed by an electrical and a non-electrical system can be calculated as:

$$Q_{el}^H = Q^{HD} SEH_{el} \quad (A.40)$$

$$Q_{nel,fuel}^H = Q^{HD} SEH_{nel,fuel} \quad (A.41)$$

where:

Q^{HD} : The total annual heating energy demand (MJ/year)

$$SEH_{el} = \sum_{ehsi=1}^{EHSI} \sum_{ehsj=1}^{EHSJ_{ehsi}} \left(\frac{x_{ehsi,ehsj}^{EHS}}{n_{ehsi,ehsj}^{EHS}} \right) + \sum_{ehcsi=1}^{EHCSI} \sum_{ehcsj=1}^{EHCSJ_{ehcsi}} \left(\frac{x_{ehcsi,ehcsj}^{EHCS}}{n_{ehcsi,ehcsj}^{EHCS}} \right) + \sum_{ehwsi=1}^{EHWSI} \sum_{ehwsj=1}^{EHW SJ_{ehwsi}} \left(\frac{x_{ehwsi,ehwsj}^{EHS}}{n_{ehwsi,ehwsj}^{EHS}} \right) \quad (A.42)$$

$$SEH_{nel,fuel} = \sum_{nehsi=1}^{NEHSI} \sum_{neh sj=1}^{NEHSJ_{ehi}} \left(\frac{x_{neh si,neh sj}^{NEHS}}{n_{neh si,neh sj}^{NEHS}} \right) + \sum_{neh wsi=1}^{NEHWSI} \sum_{neh w sj=1}^{NEHWSJ_{ehw si}} \left(\frac{x_{neh w si,neh w sj}^{NEHWS}}{n_{neh w si,neh w sj}^{NEHWS}} \right) \quad (A.43)$$

SEH_{el} and $SEH_{nel,fuel}$: The efficiency of the chosen system for heating

$n_{ehsi,ehsj}^{EHS}$, $n_{ehci,ehcj}^{EHC}$, $n_{ehwi,ehwj}^{EHW}$: The efficiency (%) of the electrical systems $ehsj$, $ehcsj$ and $ehwsj$ of the respected categories $ehsi$, $ehcsi$ and $ehwsi$

$n_{neh si,neh sj}^{NEHS}$, $n_{neh w si,neh w sj}^{NEHWS}$: The efficiency (%) of the non-electrical systems $neh sj$ and $neh w sj$ of the respected categories $neh si$ and $neh w si$

The annual heating demand can be calculated by summing the demand of each month:

$$Q^{HD} = \sum_{m=1}^{12} Q_m^{HD} \quad (\text{A.44})$$

The heating demand for each month is equal to the sum of heat losses, i.e. monthly transmission $Q_{T,m}$ (kWh/month) and ventilation losses $Q_{VEN,m}$ (kWh/month), minus internal heat gains $Q_{INHG,m}$ (kWh/month) and solar gains $Q_{SL,m}$ (kWh/month) [16]. Regarding the solar gains only the direct solar gains from window are taken into account and not the indirect (such the absorbance of solar radiation of the walls) despite they might offer a small heat gain [40]:

$$Q_m^{HD} = \begin{cases} HS_m F_{conv} (Q_{T,m} + Q_{VEN,m} - Q_{INHG,m} - Q_{SL,m}), & \text{if positive} \\ 0, & \text{else} \end{cases} \quad (\text{A.45})$$

$$Q_{T,m} = BLC (T_{IH} - T_{o,m}) t_m \quad (\text{A.46})$$

$$Q_{VEN,m} = \rho_{air} c_{pair} ACH \cdot V \cdot (T_{IH} - T_{o,m}) t_m / 3600 \quad (\text{A.47})$$

$$Q_{INHG,m} = (n_{people} Q_{people,m} + Q_{eah,m}) t_m \quad (\text{A.48})$$

$$Q_{SL,m} = \sum_{wn=1}^{WN} \left(A_{wn}^{WIN} F_{F,wn} F_{S,wn} F_{CM,wn} I_{SL,wn,m} t_d \sum_{z=1}^Z \sum_{t=1}^{T_z} (x_{zt}^{WIN} g_{zt}^{WIN}) \right) \quad (\text{A.49})$$

where:

HS_m : Parameter indicating if heating is required for month m (binary variable with values 1 or 0)

F_{conv} : conversion factor (MJ/kWh)

BLC : Building load coefficient (W/K)

T_{IH} : Internal design temperature for heating season (K)

$T_{o,m}$: Average external temperature of month m (K)

t_m : Month duration in hours (h/month)

t_d : Month duration in days (days/month)

ρ_{air} : Air density (kg/m³)

c_{pair} : Specific heat of air (kJ/kg K)

ACH : Air changes per hour (h⁻¹)

V : Internal Volume of the Building (m³)

A_{wn}^{WIN} : Area of window wn (m^2), where $wn = 1, \dots, WN$

$F_{F,wn}$: Window frame factor (%)

$F_{SM,wn}$: Window shading correction factor (%)

$F_{CM,wn}$: Window correction factor for movable devices (%)

$I_{SL,wn,m}$: Solar radiation on window wn , under a certain tilt and orientation ($kwh/m^2/day$)

g_{st}^{WIN} : Effective total solar energy transmittance (%) of window sub-type t of type z

n_{people} : number of people living in the building

$Q_{human,m}$: Heat emitted per person from radiation ($W/person$)

$Q_{eah,m}$: Heat emitted by electrical equipment

Moreover the BLC of a building can be calculated as:

$$BLC = \sum_{com} A_{com} U_{com} b_{com} \quad (A.50)$$

Where

com : is a building envelope component

A_{com} : surface area (m^2)

U_{com} : total heat transfer coefficient (W/m^2K)

b_{com} : temperature correction factor, between 0 for unheated surfaces (e.g. floors or basements)

and 1 for components that face outside air

In detail the BLC is equal to:

$$\begin{aligned} BLC = & \sum_{dr=1}^{DR} (A_{dr}^{DOOR} b_{dr}^{DOOR}) \sum_{d=1}^D (x_d^{DOOR} U_d^{DOOR}) + \sum_{wn=1}^{WN} (A_{wn}^{WIN} b_{wn}^{WIN}) \sum_{z=1}^Z \sum_{t=1}^{T_z} (x_{zt}^{WIN} U_{zt}^{WIN}) \\ & + \sum_{wl=1}^{WL} (A_{wl}^{WALL} b_{wl}^{WALL}) \sum_{w=1}^W (x_w^{WALL} U_w^{WALL}) + \sum_{ce=1}^{CE} (A_{ce}^{CEIL} b_{ce}^{CEIL}) \sum_{r=1}^R (x_r^{CEIL} U_r^{CEIL}) \\ & + \sum_{fl=1}^{FL} (A_{fl}^{FLO} b_{fl}^{FLO}) \sum_{h=1}^H (x_h^{FLO} U_h^{FLO}) \end{aligned} \quad (A.51)$$

In this methodology the overall heat transfer coefficient U_{total} is used in order to take into account the phenomenon of heat transfer by convection and radiation mechanisms. For doors and windows the manufacturers usually provide the U_{value} instead of the thermal conductivity and the thickness. For multi-layer components the calculation of the total heat transfer coefficient (W/m^2K) takes into account the thickness of each layer, the thermal

conductivity and the inside and outside heat convection coefficient to air. Therefore the following equations are used:

$$U_v^{\text{DOOR}} = \left(\frac{1}{h_i} + \frac{1}{U_{\text{value, door}}} + \frac{1}{h_o} \right)^{-1} \quad (\text{A.52})$$

$$U_w^{\text{WIN}} = \left(\frac{1}{h_i} + \frac{1}{U_{\text{value, win}}} + \frac{1}{h_o} \right)^{-1} \quad (\text{A.53})$$

$$U_w^{\text{WALL}} = \left(\frac{1}{h_i} + \sum_{nwl=1}^{NWL_w} \left(\frac{l_{w, nwl}^{\text{WALL}}}{kk_{w, nwl}^{\text{WALL}}} \right) + \sum_{y=1}^{Y_w} \sum_{p=1}^{P_{wy}} \left(\frac{l_{wyp}^{\text{WALL}}}{k_{wyp}^{\text{WALL}}} x_{wyp}^{\text{WALL}} \right) + \frac{1}{h_o} \right)^{-1} \quad (\text{A.54})$$

$$U_d^{\text{CEIL}} = \left(\frac{1}{h_i} + \sum_{ncl=1}^{NCL_d} \left(\frac{l_{r, kcl}^{\text{CEIL}}}{kk_{r, ncl}^{\text{CEIL}}} \right) + \sum_{f=1}^{F_d} \sum_{a=1}^{A_{df}} \left(\frac{l_{rfa}^{\text{CEIL}}}{k_{rfa}^{\text{CEIL}}} x_{rfa}^{\text{CEIL}} \right) + \frac{1}{h_o} \right)^{-1} \quad (\text{A.55})$$

$$U_h^{\text{FLO}} = \left(\frac{1}{h_i} + \sum_{nfl=1}^{NFL_h} \left(\frac{l_{h, nfl}^{\text{FLO}}}{kk_{h, nfl}^{\text{FLO}}} \right) + \sum_{e=1}^{E_h} \sum_{g=1}^{G_{he}} \left(\frac{l_{heg}^{\text{FLO}}}{k_{heg}^{\text{FLO}}} x_{heg}^{\text{FLO}} \right) + \frac{1}{h_o} \right)^{-1} \quad (\text{A.56})$$

where h_i and h_o represent the combined convection radiation coefficients (W/m^2K)

A.2.1.2 Primary Energy Consumption for Cooling

Similarly to the heating energy consumption calculations the total annual primary energy consumption for cooling can be calculated as:

$$Q_C = \frac{Q_{el}^C f^{\text{grid}}}{n_{\text{grid}}} \quad (\text{A.57})$$

Where:

Q_{el}^C : Energy consumed by an electrical system used for cooling (MJ/year)

The energy consumed by an electrical system can be calculated as:

$$Q_{el}^C = Q^{CD} SEC_{el} \quad (\text{A.58})$$

where:

Q^{CD} : The total annual cooling energy demand (MJ/year)

$$SEC_{el} = \sum_{ecsi=1}^{ECSI} \sum_{ecsj=1}^{ECSJ_{ecsi}} \left(\frac{X_{ecsi, ecjsj}^{ECS}}{n_{ecsi, ecjsj}^{ECS}} \right) + \sum_{ehcsi=1}^{EHCSI} \sum_{ehcsj=1}^{EHCSJ_{ehcsi}} \left(\frac{X_{ehcsi, ehcsj}^{EHCS}}{n_{ehcsi, ehcsj}^{EHCS}} \right) \quad (A.59)$$

SEC_{el} : The efficiency of the chosen system providing cooling energy

$n_{ecsi, ecjsj}^{ECS}$, $n_{ehcsi, ehcsj}^{EHCS}$: The efficiency (%) of the electrical systems $ecsj$, $ehcsj$ of the respected categories $ecsi$ and $ehcsi$

The total annual cooling energy demand can be calculated by summing the cooling energy demand of each month:

$$Q^{CD} = \sum_{m=1}^{12} Q_m^{CD} \quad (A.60)$$

The cooling energy demand for each month is equal to the sum of heat losses, i.e. monthly transmission $Q_{T,m}$ (kWh/month) and ventilation losses $Q_{VEN,m}$ (kWh/month), minus internal heat gains $Q_{INHG,m}$ (kWh/month) and solar gains $Q_{SL,m}$ (kWh/month). The calculation of cooling energy demand is similar to the one for heating energy demand, but in this case the sol-air temperature is used which takes into account the effect of solar radiation on the outside temperature [27]:

$$Q_m^{CD} = \begin{cases} CS_m F_{conv} (Q_{INHG,m} + Q_{SL,m} - Q_{T,m} - Q_{VEN,m}), & \text{if positive} \\ 0, & \text{else} \end{cases} \quad (A.61)$$

$$Q_{VEN,m} = \rho_{air} c_{pair} ACH \cdot V \cdot (T_{IC} - T_{o,m}) t_m / 3600 + \rho_{air} h_{fg} ACH \cdot V \cdot (w_i - w_{o,m}) t_m / 3600 \quad (A.62)$$

$$Q_{T,m} = BLC (T_{IC} - T_{sol-air,m}) t_m \quad (A.63)$$

$$T_{sol-air,m} = T_{o,m} + \frac{a \cdot \dot{q}_{sol}}{h_o} \quad (A.64)$$

CS_m : Parameter indicating if heating is required for month m (binary variable)

T_{IC} : Internal design temperature for cooling season (K)

h_{fg} : latent heat of vaporization (usually 2340 kJ/kg)

w_i : Specific humidity indoors ($\frac{\text{kg}_{\text{wat}}}{\text{kg}_{\text{air}}}$)

$w_{o,m}$: Specific humidity outdoors ($\frac{\text{kg}_{\text{wat}}}{\text{kg}_{\text{air}}}$)

$T_{\text{sol-air}}$: Sol-air temperature (K)

a : Absorptivity of the material

q_{sol} : Solar radiation (W/m^2)

A.2.1.3 Primary Energy Consumption for Domestic Hot Water

The total annual primary energy consumption for DHW supply would be equal to:

$$Q_{\text{DHW}} = \frac{Q_{\text{el}}^{\text{W}} f^{\text{grid}}}{n_{\text{grid}}} + \sum_{\text{fuel}=1}^{\text{FUEL}} Q_{\text{nel, fuel}}^{\text{W}} \quad (\text{A.65})$$

where:

Q_{el}^{W} : Energy consumed by a DHW system using electricity (MJ/year)

$Q_{\text{nel, fuel}}^{\text{W}}$: Energy consumed by a DHW system using a *fuel*, $\text{fuel} = 1, \dots, \text{FUEL}$ (MJ/year)

The energy consumption of an electrical and a non-electrical system can be calculated as:

$$Q_{\text{el}}^{\text{W}} = Q^{\text{WD}} \text{SEW}_{\text{el}} \quad (\text{A.66})$$

$$Q_{\text{nel, fuel}}^{\text{W}} = Q^{\text{WD}} \text{SEH}_{\text{nel, fuel}} \quad (\text{A.67})$$

where:

Q^{WD} : The total annual energy demand for DHW (MJ/year)

$$\text{SEW}_{\text{el}} = \sum_{\text{ewsi}=1}^{\text{EWSI}} \sum_{\text{ewsj}=1}^{\text{EWSJ}_{\text{ewsi}}} \left(\frac{x_{\text{ewsi, ewsj}}^{\text{EWS}}}{n_{\text{ewsi, ewsj}}^{\text{EWS}}} \right) + \sum_{\text{ehwsi}=1}^{\text{EHWSI}} \sum_{\text{ehwsj}=1}^{\text{EHWSJ}_{\text{ehwsi}}} \left(\frac{x_{\text{ehwsi, ehwsj}}^{\text{EHWS}}}{n_{\text{ehwsi, ehwsj}}^{\text{EHWS}}} \right) \quad (\text{A.68})$$

$$\text{SEW}_{\text{nel, fuel}} = \sum_{\text{newsi}=1}^{\text{NEWSI}} \sum_{\text{newsj}=1}^{\text{NEWSJ}_{\text{newsi}}} \left(\frac{x_{\text{newsi, newsj}}^{\text{NEWS}}}{n_{\text{newsi, newsj}}^{\text{NEWS}}} \right) + \sum_{\text{nehwsi}=1}^{\text{NEHWSI}} \sum_{\text{nehwsj}=1}^{\text{NEHWSJ}_{\text{nehwsi}}} \left(\frac{x_{\text{nehwsi, nehwsj}}^{\text{NEHWS}}}{n_{\text{nehwsi, nehwsj}}^{\text{NEHWS}}} \right) \quad (\text{A.69})$$

SEW_{el} and $\text{SEW}_{\text{nel, fuel}}$: The efficiency of the chosen system providing hot water

$n_{\text{ewsi, ewsj}}^{\text{EWS}}$, $n_{\text{ehwsi, ehwsj}}^{\text{EHWS}}$: The efficiency (%) of the electrical systems *ewsj* and *ehwsj* of the respected categories *ewsi* and *ehwsi*

$n_{newsi, newsj}^{NEWS}$, $n_{nehwi, nehwi}^{NEHW}$: Denotes the generation efficiency (%) of the non- electrical systems $newsj$ and $nehwsj$ of the respected categories $newsi$ and $nehwsj$

The annual DHW energy demand can be calculated by summing the demand of each month:

$$Q^{WD} = \sum_{m=1}^{12} (DQ_m^{DHW}) \quad (A.70)$$

The net DHW demand for each month is equal to the average monthly hot water demand minus the energy a solar collector system provides (in case one is selected):

$$DQ_m^{DHW} = \begin{cases} WS_m F_{conv} (Q_{dhwu, m} - Q_{dSLC, m}), & \text{if } Q_{dhwu, m} \geq Q_{dSLC, m} \\ 0, & \text{else} \end{cases} \quad (A.71)$$

Where:

WS_m : Parameter indicating if DHW is required for month m (binary variable)

$Q_{dhwu, m}$: average monthly demand for DHW supply (MJ/month) calculated as:

$$Q_{dhwu, m} = \dot{m}_w \rho_w c_{pw} (T_{DHW} - T_{DCW, m}) t_m \quad (A.72)$$

\dot{m}_w : Rate of consumption of hot water at each day (m^3/s)

T_{DHW} : The base temperature set for the DHW system (K)

$T_{DCW, m}$: The temperature of the cold water supply at month m (K)

ρ_w : The water density (kg/m^3)

c_{pw} : Specific heat of water ($kJ/kg K$)

$Q_{dSLC, m}$: the monthly hot water demand (MJ/month) provided from a solar collector system (in case one is selected)

$$Q_{dSLC, m} = F_{conv} A_{SLC} F_{S, SLC} I_{SL, SLC, m} t_d \sum_{slci=1}^{SLCI} x_{slcj, slci}^{SLC} n_{slcj, slci}^{SLC} \quad (A.73)$$

A_{SLC} : Area of solar collector (m^2)

$F_{S, SLC}$: Correction factor for shading (%)

$I_{SL, SLC, m}$: Solar radiation incident on a solar collector type $slcj$ of category $slci$, under a specific tilt and orientation ($kwh/m^2/day$)

$n_{slcj, slci}^{SLC}$: efficiency of a solar collector type $slcj$ of the category $slci$ (%)

A.2.1.4 Primary Energy Consumption for Lighting

The total annual primary energy consumption for lighting purposes is calculated as:

$$Q_L = \frac{Q_{el}^L f^{grid}}{n_{grid}} \quad (A.74)$$

where:

Q_{el}^L : is the annual electrical energy consumed for lighting (MJ/year)

The electrical energy consumption for providing lighting is equal to:

$$Q_{el}^L = Q^{LD} SEL_{el} \quad (A.75)$$

where:

Q^{LD} : Total annual demand for electricity for lighting (MJ/year)

$SEL_{el} = 1$, assuming no losses of electricity from supply to consumption

The annual energy demand for lighting can be calculated by summing the demand of each month:

$$Q^{LD} = \sum_{m=1}^{12} Q_m^{LD} \quad (A.76)$$

It is assumed that the lamps would be operating the same number of hours each day and consequently all the months of the year. The energy consumption of lamps can be calculated as:

$$Q_m^{LD} = F_{conv} t_d \sum_{l=1}^L (P_{L,l} f_{use,l}) \sum_{li=1}^{Ll} \sum_{lj=1}^{Lj} x_{li,lj}^L \quad (A.77)$$

$l = 1, \dots, L$: Number of lamps

$P_{L,l}$: Lamp power rating (kW)

$f_{use,l}$: Time that the device is used (h/day)

A.2.1.5 Primary Energy Consumption for Electrical appliances

The total annual primary energy consumption for the operation of the electrical appliances is calculated as:

$$Q_A = \frac{Q_{el}^A f^{grid}}{n_{grid}} \quad (A.78)$$

Where:

Q_{el}^A : is the annual energy (electricity) consumed for operation of electrical appliances (MJ/year)

The electrical energy consumed for operation of electrical appliances is:

$$Q_{el}^A = Q^{AD} SEA_{el} \quad (A.79)$$

Where:

Q^{AD} : Total annual demand for electricity for operation of electrical appliances (MJ/year)

$SEA_{el} = 1$, assuming no losses of electricity from supply to consumption

The annual energy demand for the operation of electrical appliances can be calculated by summing the demand of each month:

$$Q^{AD} = \sum_{m=1}^{12} Q_m^{AD} \quad (A.80)$$

It is assumed that the electrical appliances would be operating the same number of hours each day and consequently all the months of the year. The energy consumption of electrical appliances can be calculated as:

$$Q_m^{AD} = F_{conv} t_{d,m} \sum_{eai=1}^{EAI} \left(P_{A,eai} f_{use,eai} f_{load,eai} \sum_{eaj=1}^{EAI_{eai}} X_{eai,eaj}^{EA} \right) \quad (A.81)$$

$P_{A,a}$: Electric appliance power rate (W)

$f_{use,a}$: Time that the device is used (h/day)

$f_{load,a}$: Load factor of the device (%)

A.2.1.6 Electricity supply

The total annual demand for electrical energy is equal to the electricity consumption for heating, cooling, DHW, lighting, and operation of the electrical appliances:

$$Q_{EL}^D = Q_{el}^H + Q_{el}^C + Q_{el}^W + Q_{el}^L + Q_{el}^A \quad (A.82)$$

The annual electricity demand of the electrical systems consists of the average demand for electricity supply from the grid $Q_{el,grid}$, reduced by the electricity provided by a RES system $Q_{el,alt}$, in case one is selected and is operating:

$$Q_{el, alt} = \sum_{resi=1}^{RESI} \sum_{resj=1}^{RESI_{ehci}} Q_{el, resi, resj} X_{resi, resj}^{RES} \quad (A.83)$$

Where

$Q_{el,resi,resj}$: electricity generation from a RES system $resj$ of category $resi$ (MJ/year)

The renewable sources that could be used to provide electricity are solar energy (photovoltaic systems) or wind energy (wind turbines). Moreover, it is further assumed that all the electricity generated from RES would be either used in the building or exported to the grid [32]. Therefore, the total supply from the grid would be equal to:

$$Q_{el, grid} = \begin{cases} (Q_{EL}^D - Q_{el, alt}), & \text{if } Q_{EL}^D > Q_{el, alt} \\ 0, & \text{else} \end{cases} \quad (A.84)$$

A.2.2 Initial Investment Cost

As it was mentioned before, several approaches regarding the cost have been made in such models. Similarly to [16] in this model the initial investment cost is used which is defined as the initial cost of acquisition of the components and the cost of installation. The initial investment cost for the proposed components would be equal to:

$$\begin{aligned} INVCOST = & COST_{DOR} + COST_{WIN} + COST_{WAL} \\ & + COST_{CEIL} + COST_{FLO} + COST_{HS} \\ & + COST_{CS} + COST_{WS} + COST_{HCS} \\ & + COST_{HWS} + COST_{SLC} + COST_{RES} \\ & + COST_{LIGHT} + COST_{EA} \end{aligned} \quad (A.85)$$

Independently, the cost for each component can be calculated as:

$$COST_{DOR} = \sum_{dr=1}^{DR} (A_{dr}^{DOOR}) \sum_{d=1}^D (x_d^{DOOR} C_d^{DOOR}) \quad (A.86)$$

$$COST_{WIN} = \sum_{wn=1}^{WN} (A_{wn}^{WIN}) \sum_{s=1}^S \sum_{t=1}^{T_s} (x_{st}^{WIN} C_{st}^{WIN}) \quad (A.87)$$

$$COST_{WAL} = \sum_{wl=1}^{WAL} (A_{wal}^{WAL}) \sum_{w=1}^W \left(x_w^{WAL} \left(\sum_{nwl=1}^{NWL_w} (CK_{w, nwl}^{mWALL}) + \sum_{y=1}^{Y_w} \left(\sum_{p=1}^{P_{wy}} (x_{wyp}^{mWALL} C_{wyp}^{mWALL}) \right) \right) \right) \quad (A.88)$$

$$COST_{CEIL} = \sum_{ce=1}^{CE} (A_{ce}^{CEIL}) \sum_{d=1}^D \left(x_d^{CEIL} \left(\sum_{ncl=1}^{NCL_r} (CK_{d, ncl}^{mCEIL}) + \sum_{f=1}^{F_r} \left(\sum_{a=1}^{A_{rf}} (x_{rfa}^{mCEIL} C_{rfa}^{mCEIL}) \right) \right) \right) \quad (A.89)$$

$$COST_{FLO} = \sum_{fl=1}^{FL} (A_{fl}^{FLO}) \sum_{h=1}^H \left(x_h^{FLO} \left(\sum_{nfl=1}^{NFL_h} (CK_{h, nfl}^{mFLO}) + \sum_{e=1}^{E_h} \left(\sum_{g=1}^{C_{he}} (x_{heg}^{mFLO} C_{heg}^{mFLO}) \right) \right) \right) \quad (A.90)$$

$$COST_{HS} = \sum_{ehsi=1}^{EHSI} \sum_{ehsj=1}^{EHSJ_{ehsi}} (x_{ehsi,ehsj}^{EHS} CST_{ehsi,ehsj}^{EHS}) + \sum_{nehsi=1}^{NEHSI} \sum_{nehsj=1}^{NEHSJ_{ehsi}} (x_{nehsi,nehjsj}^{NEHS} CST_{nehsi,nehjsj}^{NEHS}) \quad (A.91)$$

$$COST_{CS} = \sum_{ecsi=1}^{ECSI} \sum_{ecsj=1}^{ECSJ_{eci}} (x_{ecsi,ecsj}^{ECS} CST_{ecsi,ecsj}^{ECS}) \quad (A.92)$$

$$COST_{WS} = \sum_{ewsi=1}^{EWSI} \sum_{ewsj=1}^{EWSJ_{ewi}} (x_{ewsi,ewsj}^{EWS} CST_{ewsi,ewsj}^{EWS}) + \sum_{newsi=1}^{NEWSI} \sum_{newsj=1}^{NEWSJ_{ehi}} (x_{newsi,newsj}^{NEWS} CST_{newsi,newsj}^{NEWS}) \quad (A.93)$$

$$COST_{HCS} = \sum_{ehcsi=1}^{EHCSI} \sum_{ehcsj=1}^{EHCSJ_{ehci}} (x_{ehcsi,ehcsj}^{EHCS} CST_{ehcsi,ehcsj}^{EHCS}) \quad (A.94)$$

$$COST_{HWS} = \sum_{ehwsi=1}^{EHWSI} \sum_{ehwsj=1}^{EHW SJ_{ehwi}} (x_{ehwsi,ehwsj}^{EHWS} CST_{ehwsi,ehwsj}^{EHWS}) + \sum_{nehwsi=1}^{NEHW SI} \sum_{nehwsj=1}^{NEHW SJ_{ehwsi}} (x_{nehwsi,nehwsj}^{NEHWS} CST_{nehwsi,nehwsj}^{NEHWS}) \quad (A.95)$$

$$COST_{SLC} = \sum_{slci=1}^{SLCI} \sum_{slcj=1}^{SLCJ} \left(x_{slci,slcj}^{SLC} CST_{slci,slcj}^{SLC} \right) \quad (A.96)$$

$$COST_{RES} = \sum_{resi=1}^{RESI} \sum_{resj=1}^{RESJ_{ehci}} \left(x_{resi,resj}^{RES} CST_{resi,resj}^{RES} \right) \quad (A.97)$$

$$COST_{LIGHT} = L \sum_{li=1}^{LI} \sum_{lj=1}^{LJ_{li}} \left(x_{li,lj}^L CST_{li,lj}^L \right) \quad (A.98)$$

$$COST_{EA} = \sum_{eai=1}^{EAI} \sum_{eaj=1}^{EAJ_{eai}} \left(x_{eai,eaj}^{EA} CST_{eai,eaj}^{EA} \right) \quad (A.99)$$

Where,

C_v^{DOOR} : the initial investment cost for a door of type d (£/m²)

C_{zt}^{WIN} : the initial investment cost for a window of sub-type t of type z (£/m²)

$CK_{w,nwl}^{mWALL}$, $CK_{r,ncl}^{mCEIL}$, $CK_{h,nfl}^{mFLO}$: the initial investment costs for the materials used in the known layers nwl , of wall structure w , ncl of ceiling structure r and nfl layers of floor structure h (£/m²)

C_{wyp}^{mWALL} , C_{rfa}^{mCEIL} , C_{heg}^{mFLO} : the initial investment costs for the material p that is used in the unknown layer y of wall structure w , the material a that is used in the unknown layer f of ceiling structure r and the material g that is used in the unknown layer e of floor structure h (£/m²)

$CST_{ehsi,ehsj}^{EHS}$, $CST_{nehsj,nehsi}^{NEHS}$: the initial investment cost for the electrical heating system $ehsj$ of category $ehsi$ and the non-electrical heating system $nehsj$ of category $nehsi$ (£)

$CST_{ecsj,ecsi}^{ECS}$: the initial investment cost for the electrical cooling system $ecsj$ of category $ecsi$ (£)

$CST_{ewsj,ewsi}^{EWS}$, $CST_{newsj,newsi}^{NEWS}$: the initial investment cost for the electrical DHW system $ewsj$ of category $ewsi$ and the non-electrical DWH system $newsj$ of category $newsi$ (£)

$CST_{ehcsj,ehcsi}^{EHCS}$: the initial investment cost for the electrical heating-cooling system $ehcsj$ of category $ehcsi$ (£)

$CST_{ehwsi, ehwsj}^{EHWS}$, $CST_{nehwsi, nehwsj}^{NEHSW}$: the initial investment cost for the electrical heating-DHW system $ehwsj$ of category $ehwsi$ and the non-electrical heating-DWH system $nehwsj$ of category $nehwsi$ (£)

$CST_{slci, slcj}^{SLC}$: the initial investment cost for the solar collector system $slcj$ of category $slci$ (£)

$CST_{resi, resj}^{RES}$: the initial investment cost for the RES electricity system $resj$ of category $resi$ (£)

$CST_{li, lj}^L$: the initial investment cost for the lamp lj of category li (£)

$CST_{eai, eaj}^{EA}$: the initial investment cost for the electrical appliance eaj of category eai (£)

A.3 Objective Functions

A.3.1 The Case of a New Building

In order to determine the optimal prioritization of the energy efficiency measures in a new building, the primary energy consumption and the initial investment cost criteria must be minimized according to the procedure described in subsections A.2.1 and A.2.2 respectively:

$$\begin{aligned} \min [g_1(\mathbf{x})] &= Q_T \\ \min [g_2(\mathbf{x})] &= \text{INVCOST} \end{aligned} \tag{A.100}$$

Subject to

Constraints: (A.1) - (A.99)

A.3.2 The Case of Retrofitting an Existing Building

For the case of retrofitting an existing building the methodology is similar to that of a new building. However, in this case the objectives would be to achieve maximum primary energy savings with minimal initial investment cost. Therefore, the primary energy consumption of the existing building before any retrofit action must be calculated.

The primary energy consumption of an existing building is calculated with the methodology described in subsection A.2.1. However, in this case there are no decision variables. Also, the constraints regarding the components of the building's envelope as were set in subsection A.2.1 might not apply as an existing building theoretically might have more than one type of doors, windows etc. The procedure used in Section A.2.1 is followed similarly:

The total annual primary energy consumption of an existing building can be calculated using equation (A.38) and is equal to:

$$Q_{T_pre} = Q_H + Q_C + Q_{DHW} + Q_L + Q_A \quad (\text{A.101})$$

Where:

Q_{T_pre} : The annual primary energy consumption before any retrofit action.

Moreover, it is assumed that an existing building before retrofit would not have RES to provide electrical energy.

To calculate the primary energy consumption after the retrofit actions (Q_{T_post}) on a building the procedure in subsection A.2.1 is followed again. Moreover, it is assumed that in the case of retrofitting an existing building the wall, ceilings and floor structures would not be changed. Hence, the decision variables (A.5), (A.9) and (A.10) have already value equal to 1. Insulation layers may exist in some components but also they could be applied to the other components.

The initial investment cost of the components for retrofitting a building, represents the cost acquisition and installation of the proposed components and can be calculated similarly to subsection A.2.2. The variables $CK_{w,kwl}^{mWALL}$, $CK_{d,kcl}^{mCEIL}$ and $CK_{d,kfl}^{mFLO}$ are equal to 0 as they already exist.

The criteria to find the best solution are the energy savings and the initial cost of the investment. In this case energy savings must be maximized and the investment cost must be minimized:

$$\begin{aligned} \max [g_1(\mathbf{x})] &= Q_{T_pre} - Q_{T_post} \\ \min [g_2(\mathbf{x})] &= \text{INVCOST} \end{aligned} \quad (\text{A.102})$$

Subject to

Constraints: (A.1) - (A.99), except those excluded in this subsection.

Given that Q_{T_pre} is a constant parameter of the model, the first objective function of (101) is actually equivalent to the first objective function of (99).

Appendix “B”

Available online.

Appendix “C”

Available online.