



THE UNIVERSITY *of* EDINBURGH

Edinburgh Research Explorer

Incorporating forecasting and peer-to-peer negotiation frameworks into a distributed model predictive control approach for meshed electric networks

Citation for published version:

Baldivieso Monasterios, PR, Verba, N, Morris, E, Morstyn, T, Konstantopoulos, G, Gaura, E & McArthur, S 2022, 'Incorporating forecasting and peer-to-peer negotiation frameworks into a distributed model predictive control approach for meshed electric networks', *IEEE Transactions on Control of Network Systems*, vol. 9, no. 3, pp. 1556-1568. <https://doi.org/10.1109/TCNS.2022.3158806>

Digital Object Identifier (DOI):

[10.1109/TCNS.2022.3158806](https://doi.org/10.1109/TCNS.2022.3158806)

Link:

[Link to publication record in Edinburgh Research Explorer](#)

Document Version:

Peer reviewed version

Published In:

IEEE Transactions on Control of Network Systems

General rights

Copyright for the publications made accessible via the Edinburgh Research Explorer is retained by the author(s) and / or other copyright owners and it is a condition of accessing these publications that users recognise and abide by the legal requirements associated with these rights.

Take down policy

The University of Edinburgh has made every reasonable effort to ensure that Edinburgh Research Explorer content complies with UK legislation. If you believe that the public display of this file breaches copyright please contact openaccess@ed.ac.uk providing details, and we will remove access to the work immediately and investigate your claim.



Incorporating forecasting and peer-to-peer negotiation frameworks into a distributed model predictive control approach for meshed electric networks

Pablo R. Baldivieso Monasterios¹, Nandor Verba², Euan A Morris⁴,
Thomas Morstyn³, George. C. Konstantopoulos¹, Elena Gaura², and Stephen McArthur⁴

Abstract—Continuous integration of renewable energy sources into power networks is causing a paradigm shift in energy generation and distribution with regards to trading and control; the intermittent nature of renewable sources affects pricing of energy sold or purchased; the networks are subject to operational constraints, voltage limits at each node, rated capacities for the power electronic devices, current bounds for distribution lines. These economic and technical constraints coupled with intermittent renewable injection may pose a threat to system stability and performance. We propose a novel holistic approach to energy trading composed of a distributed predictive control framework to handle physical interactions, *i.e.*, voltage constraints and power dispatch, together with a negotiation framework to determine pricing policies for energy transactions. We study the effect of forecasting generation and consumption on the overall network's performance and market behaviours. We provide a rigorous convergence analysis for both the negotiation framework and the distributed control. Lastly, we assess the impact of forecasting in the proposed system with the aid of testing scenarios.

Index Terms—Microgrids, Model Predictive Control, Peer-to-peer trading, Smart Local Energy Systems

I. INTRODUCTION

THE current landscape of the electricity market is characterised by the ever growing presence of renewable energy sources and a push for a deregulation of electricity markets. Both of these trends have a similar requirement: a decentralisation of operations, energy generation, control, and billing, which would grant more power to participants in the network [1]. Decentralisation of control and pricing policies within power networks enhances reliability and flexibility, *i.e.*, the systems involved are more responsive to local changes, and modifications do not require global redesigns. These allow participants to engage with each other and perform energy transactions across the system. One of the challenges associated

with implementing such decentralisation lie in combining pricing schemes with the control layer [2].

Our literature search focuses on pricing schemes, distributed control for energy systems, and the interplay them. The basic component of an energy network is a Distributed Energy Resource (DER) which encompasses renewable sources such as Photo-voltaic (PV), Wind Turbine (WT), and batteries. One of the defining features of these renewable energy sources is the intermittent energy generation patterns. From a pricing point of view, the uncertainty introduced by renewable sources affects how prices are defined; the authors in [3] propose a dynamic pricing mechanism based on demand response and feedback to address this issue. Similarly, the authors in [4] tackle the generation intermittence by combining a pricing response with traditional automatic generation controllers to ensure optimal resource allocation in the network. From an economic point of view, [5] analyses the electricity price behaviour in response to the volatility of energy generation and transmission and concludes that the efficiency of market equilibria and average prices coincide with average marginal costs. The approach taken in [6] considers coordination from the load perspective; the approach studies how selfish consumer behaviour may result in undesired fluctuations in price and load if not suitably controlled. The common thread between these approaches is that their decision making elements can be considered agents or prosumers *i.e.*, an entity capable of generating and consuming power, acting as a rational agent. Multi Agent System (MAS) provide non-centralised solutions for market negotiation, for example [7] and [8] provide a framework for energy dispatch of heterogeneous units with pricing using concepts of demand response. Furthermore, the distributed nature of MAS can allow the exploration of peer-to-peer (P2P) energy trading [9]. P2P energy trading platforms offer a way for their members to interact among them by performing energy transactions based on energy availability, see [10] for a comprehensive survey; these type of networks are spearheading an energy revolution [11]. Despite their emerging popularity, these networks present a challenge in terms of evaluation, see [12], since the metrics involved in measuring their performance can vary widely according to the services offered.

Distributed control of electric networks has been an active research field in the past years; newer methods are departing

³ Thomas Morstyn is with the School of Engineering, University of Edinburgh, Edinburgh, EH9 3JL, UK (e-mail: thomas.morstyn@ed.ac.uk).

¹ Pablo. R. Baldivieso Monasterios and George. C. Konstantopoulos are with the Department of Automatic Control & Systems Engineering, University of Sheffield, Sheffield, UK {p.baldivieso,g.konstantopoulos}@sheffield.ac.uk

² Nandor Verba and Elena Gaura are with the Faculty Research Centre for Computational science & mathematical modelling, Coventry University, Coventry, UK {ad2833,csx216}@coventry.ac.uk

⁴ Euan A. Morris and Stephen McArthur are with the Department of Electronic and Electrical Engineering, University of Strathclyde, Glasgow, UK {euan.a.morris, s.mcarthur}@strath.ac.uk

from centralised and hierarchical approaches in favour to distributed ones [13]. The distributed control of a networked system such as a Micro-Grid (MG) poses two challenges: coordination and optimality. The problem of optimal MG operation requires control laws to consider economic criteria such as generation costs, electricity prices as seen in [14] and [15]. Receding horizon techniques can cope with hard constraints and provide optimal performance to given metrics. This type of controller is capable to handle supervisory controller tasks; for example in [16], the authors use distributed Model Predictive Control (MPC) controllers for DC and AC networks respectively where the nodes of the MG solve cooperatively a convex version of the power flow equation. In [17], [18], the authors used economic MPC arguments to control the power flow and solve the economic dispatch problem. The use of receding horizon techniques on P2P schemes has been investigated in [19] where prosumers adjust their power flows based on predicted prices. Similarly, the authors in [20] and [21] use receding horizon techniques in P2P platforms to exploit its prediction capabilities, constraint handling, and optimality.

Most of these distributed control approaches employ static costs to solve their respective optimisation problem which does not capture the ever changing nature of energy markets and renewable injections. On the other hand, prosumers in P2P approaches use their energy consumption as means to affect prices but the way in which their consumption changes is not specified. In addition, P2P pricing schemes assume linear pricing policies and as a consequence abundance and scarcity of energy is treated similarly. This paper aims to combine a distributed receding horizon controller and a P2P trading scheme; our work addresses the problem of how to efficiently use batteries to modify energy prices given that, perhaps inaccurate, forecasts of generation and consumption are available to the controller. One of the benefits of such approach is that constraint satisfaction for power injections with respect to rated capacities, state of charge, and operating voltages is guaranteed. The distributed controller computes suitable set-points for each battery that minimise an economic cost criteria dependent on energy price. Each MG element obtains its cost by negotiating suitable pricing policies for selling or purchasing power from different elements in the network. A consequence of this approach is a shift of interest from choosing fixed prices, as seen in [12], [22], towards pricing policies which may reflect more accurately the abundance or scarcity of power in each node.

The contribution of this paper are as follows:

- A rigorous analysis of a novel distributed predictive controller managing interactions between local loads, DERs, and the physical network. The controller handles coupled voltage constraints; uses forecasts of generation and demand in addition to neighbouring voltage information to compute its control law. Section III-A describes the different components of the Optimal Control Problem (OCP).
- A novel agent based market negotiation framework where all network elements engage in bargaining to determine suitable pricing policies used for energy transactions. This

policies are used in the Distributed MPC cost such that performance of each MG element is optimal with respect to this cost. Section III-B states the problem and relevant definitions of this negotiation problem.

- An analysis of the interplay between the predictive controller, the agent based negotiation framework, and the forecasting mechanisms in terms of convergence to game theoretic equilibrium concepts and recursive feasibility of predictive controllers.

Notation: For a given graph $\mathcal{G} = (\mathcal{V}, \mathcal{E})$ with nodes \mathcal{V} and edges $\mathcal{E} \subseteq \mathcal{V} \times \mathcal{V}$, the node-edge matrix $\mathcal{B} \in \mathbb{R}^{|\mathcal{E}| \times |\mathcal{V}|}$ characterises the relation between nodes and edges which for edge $e = (i, j) \in \mathcal{E}$ involving nodes i and j can be defined as $[\mathcal{B}]_{ei} = 1$ if node i is the source of $e \in \mathcal{E}$, and $[\mathcal{B}]_{ej} = -1$ if node j is its sink, and zero otherwise. The 2-norm is denoted $\|x\| = \|x\|_2$. A *C-set* is a compact and convex set containing the origin; A *PC-set* is a C-set with the origin in its nonempty interior. For a given set $\mathcal{A} \subset \mathbb{R}^n$, and linear transformations $B \in \mathbb{R}^{m \times n}$ and $C \in \mathbb{R}^{n \times p}$, the image of \mathcal{A} by B is $B\mathcal{A} = \{Bx : x \in \mathcal{A}\} \subset \mathbb{R}^m$ and the preimage of \mathcal{A} by C is $C^{-1}\mathcal{A} = \{x : Cx \in \mathcal{A}\} \subset \mathbb{R}^p$.

II. PROBLEM SETUP AND BASIC FORMULATION

A. System description

Consider a connected graph $\mathcal{G} = (\mathcal{V}, \mathcal{E})$ defining an electric network. The set of nodes \mathcal{V} can be partitioned into two disjoint sets \mathcal{V}_I and \mathcal{V}_0 which correspond to the set of renewable generators and the utility electric grid respectively. When $\mathcal{V}_0 = \emptyset$, the network \mathcal{G} can be considered islanded.

1) *System Model:* Each node in $i \in \mathcal{V}_I$ comprises DER sources interfaced via power converters and local loads, see Figure 1. The DER sources with variable input such as solar PV and WT operate with a maximum point tracking rationale which enables them to extract the maximum possible energy for given environmental conditions. The discrete power dynamics for each $i \in \mathcal{V}_I$ and $h \in \mathcal{H} := \{\text{wind, PV}\}$ are:

$$S_{h,i}^+ = f_{h,i}(S_{h,i}, \Delta_{h,i}, w_{h,i}) \quad (1)$$

where $S_{h,i} = (P_{h,i}, Q_{h,i})$ denotes active and reactive power, the superscript $^+$ denotes the successor state, $w_{h,i}$ is uncontrollable input power generated by either wind or solar sources, and $\Delta_{h,i}$ is a control input ensuring seamless transmission from the energy source to the electric network. The battery dynamics are described by the following difference algebraic system:

$$C_{b,i}(\text{SoC}_i^+ - \text{SoC}_i) = -\frac{1}{R_{b,i}}(V(\text{SoC}_i) - V_{b,i}), \quad (2a)$$

$$V_{b,i}V(\text{SoC}_i) = \frac{1}{R_{b,i}}V_{b,i}^2 + g_{b,i}(S_{b,i}), \quad (2b)$$

where the state $(\text{SoC}_i, V_{b,i})$ contains the State of Charge (SoC) and battery DC voltage; $V(\text{SoC})$ is the battery output voltage that is SoC dependent; $R_{b,i}$ is the internal resistance; and $C_{b,i}$ is the battery capacity in [A h]. The nonlinear function $g_{b,i}(\cdot, \cdot)$ determines the power electronic steady-state behavior in terms of desired active and reactive desired power $S_{b,i} = (P_{b,i}, Q_{b,i})$ which we consider as inputs. The power electronic components

from all renewable sources exhibit faster dynamic behavior, therefore we can consider each node operating in a *quasi* stationary operation [23]. The algebraic constraint in (2) yields a condition to ensure the existence of a solution to the difference algebraic system which relates input power and SoC.

$$V(\text{SoC}_i)^2 \geq 4R_{b,i}P_{b,i} \quad (3)$$

The overall state for each node can be summarised in $x_i = (\{S_{h,i}\}_{h \in \mathcal{H}}, \text{SoC}_i)$, with control inputs $u_i = (\{\Delta_{w,i}\}_h, S_{b,i})$. Each DER is subject to exogenous inputs $w_{g,i} = \{w_{h,i}\}_{h \in \mathcal{H}}$ corresponding to powers injected by renewable sources. In addition, local loads connected to node i draw an *a-priori* unknown active and reactive power $S_{l,i} = (P_{l,i}, Q_{l,i}) \in \mathbb{R}^2$; however, for each $i \in \mathcal{V}_I$, the controller has access to preview information, *i.e.*, forecasts for loads and DER which satisfy the following Assumption:

Assumption 1 (Forecasting information available to the controller).

- 1) The state $x_i(k)$ and exogenous input $w_i(k) = (\{w_{h,i}(k)\}_{h \in \mathcal{H}}, S_{l,i}(k))$ are known exactly at time k ; future external inputs are not known exactly but satisfy $w_i(k+n) \in \mathbb{D}_i$ for $n \in \mathbb{N}$.
- 2) At any time step k , a prediction, $\mathbf{d}_i = \{d_i(k)\}_{k \in \mathbb{N}_{0:N-1}}$, of N future exogenous inputs¹, over a finite horizon of time, is available.

Note that we do not assume anything about the accuracy of the predictions, and in fact will allow these to vary over time (this implicitly implies that previous predictions were not accurate). In practice, the sequences \mathbf{d}_i can be obtained in form of forecasts of loads and renewable sources. The states and inputs of each node are restricted to satisfy constraints $x_i \in \mathbb{X}_i$ and $u_i \in \mathbb{U}_i$ where

Assumption 2 (Constraints). For each $i \in \mathcal{V}_I$, the sets \mathbb{X}_i and \mathbb{D}_i are C-sets. The set \mathbb{U}_i is a PC-set.

The output of each node $y_i = (P_{o,i}, Q_{o,i})$ is given by its power balance equations

$$y_i = \sum_{h \in \mathcal{H}} S_{h,i} + S_{b,i} - S_{l,i}, \quad (4)$$

which following Assumption 2 is bounded for all time $k \in \mathbb{N}$.

2) *Network model*: The network topology is characterized by the set of edges \mathcal{E} such that each $e \in \mathcal{E}$ defines the existence of a physical link between two nodes. The network topology allows us to define the set of neighbours of each $i \in \mathcal{V}$,

$$\mathcal{N}_i = \{j \in \mathcal{V} : (i, j) \in \mathcal{E}\}. \quad (5)$$

Similarly, we can define $\mathcal{E}_i \subseteq \mathcal{E}$ collecting all those edges emanating or terminating in $i \in \mathcal{V}$, *i.e.*,

$$\mathcal{E}_i = \{e \in \mathcal{E} : e = (i, j) \text{ or } e = (j, i), j \in \mathcal{V}\}.$$

For each $i \in \mathcal{V}$, the current delivered by node i is:

$$i_i = \frac{v_i}{Z_{ii}} + \sum_{(i,j) \in \mathcal{E}_i} \frac{v_i - v_j}{Z_{ij}}, \quad (6)$$

¹ $\mathbb{N}_{a:b} = \{a, a+1, \dots, b-1, b\}$ for $a, b \in \mathbb{N}$ and $a < b$.

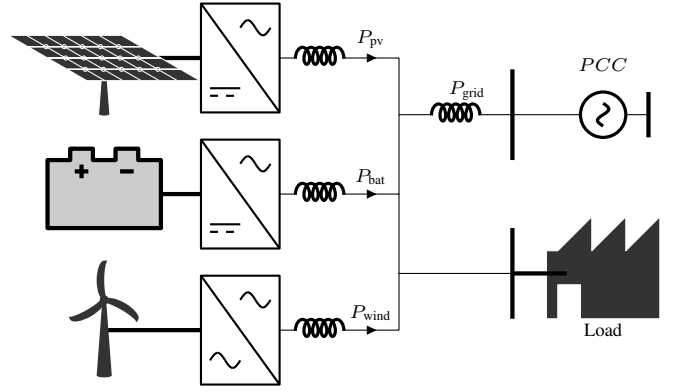


Fig. 1. Power sources comprising node Σ_i ; local energy sources together with local loads are connected to PCC.

The admittance $Z_{ij}^{-1} = G_{ij} - jB_{ij} \in \mathbb{C}$ corresponds to the line connecting the i^{th} and j^{th} nodes. The current drawn from each node $i \in \mathcal{V}_I$ can be described in terms of $S_i = (P_i, Q_i)$, *i.e.*, active and reactive power, as²

$$i_i = h_i(v_i, S_i) = \frac{1}{|v_i|^2} (P_i v_i - Q_i \mathbb{J}_2 v_i) \quad (7)$$

Furthermore, the node-edge incidence matrix can be partitioned into $\mathcal{B} = [\mathcal{B}_0 \ \mathcal{B}_I]$ corresponding to the utility grid and renewable nodes respectively. The current balance (6) for each $i \in \mathcal{V}_I$ can be rewritten as

$$h_I(v_I, S_I) - (Y_I + \mathcal{L}_I)v_I - \mathcal{B}_I^\top Y_E \mathcal{B}_0 v_0 = 0, \quad (8)$$

where $\mathcal{L}_I = \mathcal{B}_I^\top Y_E \mathcal{B}_I$ with $Y_E = \text{diag}\{Z_{ij}^{-1} : (i, j) \in \mathcal{E}\}$ the admittance of each line and Y_I the shunt admittance of each node in \mathcal{V}_I . The vector $v_I = [v_i]_{i \in \mathcal{V}_I} \in \mathbb{R}^{2|\mathcal{V}_I|}$ collects all generator node voltages, similarly S_I captures the power injected by each node, and $h_I(v_I, S_I) = [h_i(v_i, S_i)]_{i \in \mathcal{V}_I} \in \mathbb{R}^{|\mathcal{V}_I|}$. The grid voltage is given by $v_0 \in \mathbb{R}^2$ and can be characterized by following relation:

$$-(Y_0 + \mathcal{L}_0)v_0 + Y_0 E_0 - \mathcal{B}_0^\top Y_E \mathcal{B}_I v_I = 0. \quad (9)$$

Similarly to the previous case, Y_0 is a local admittance, and $\mathcal{L}_0 = \mathcal{B}_0^\top Y_E \mathcal{B}_0$. The voltage E_0 is generated at the network connection point; the nature of this quantity varies according to the operation mode: stiff grid $E_0 = (220\sqrt{2}, 0)$, a weak grid when its magnitude and angle are power dependent, or $E_0 = (0, 0)$ in case of an islanded system. The network states are given by node voltages $v = (v_0, v_I)$ lying in a constraint set $\mathbb{V} = \mathbb{R}^2 \times \prod_{i \in \mathcal{V}_I} \mathbb{V}_i$ where each set \mathbb{V}_i with $i \in \mathcal{V}_I$ satisfies

Assumption 3. The set $\mathbb{V}_i \subset \mathbb{R}^2$ is a PC-set.

Similarly, if the currents flowing through the lines $i_E = Y_E \mathcal{B} y$ are also constrained to a PC-set $\mathbb{I}_E = \prod_{e \in \mathcal{E}} \mathbb{I}_e$, *i.e.*, bounds on each RMS current, these induce constraints on

²The matrix $\mathbb{J}_2 = \begin{bmatrix} 0 & -1 \\ 1 & 0 \end{bmatrix}$ is a complex structure on \mathbb{R}^2 . Any complex number $a + ib$ can be written as a 2×2 matrix or a vector in \mathbb{R}^2 as

$$a + ib \iff \begin{bmatrix} a \\ b \end{bmatrix} \iff \begin{bmatrix} a & -b \\ b & a \end{bmatrix} = a \begin{bmatrix} 1 & 0 \\ 0 & 1 \end{bmatrix} + b \begin{bmatrix} 0 & -1 \\ 1 & 0 \end{bmatrix}$$

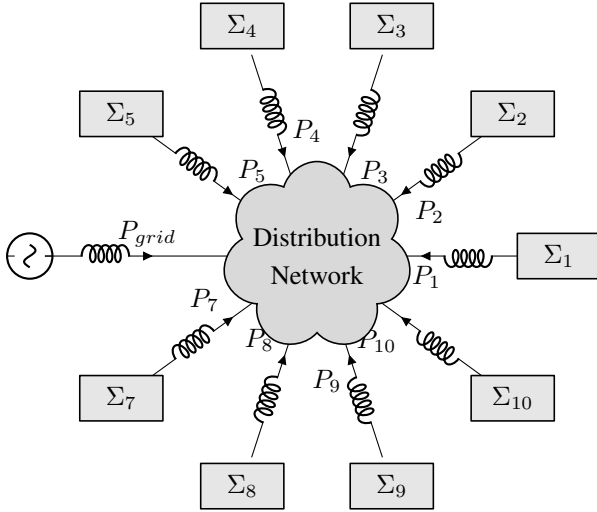


Fig. 2. Physical network: each node Σ_i is interfaced via inductive lines to a distribution network which may have a meshed topology.

voltages by virtue of the algebraic relation $i_E = \mathcal{B}_0 v_0 + \mathcal{B}_I v_I$. Following (9), the closed form of these constraints are:

$$v_I \in \tilde{A}^{-1}(-\tilde{B}E_0 \oplus \mathbb{I}_E),$$

where $\tilde{A} = Y_E(\mathcal{B}_I - \mathcal{B}_0(Y_0 + \mathcal{L}_0)^{-1}\mathcal{B}_0^\top Y_E \mathcal{B}_I)$ and $\tilde{B} = Y_E \mathcal{B}_0(Y_0 + \mathcal{L}_0)^{-1}Y_0$. The overall voltage constraint set is

$$\mathbb{V}_I = \tilde{A}^{-1}(-\tilde{B}E_0 \oplus \mathbb{I}_E) \cap \prod_{i \in \mathcal{V}_I} \mathbb{V}_i. \quad (10)$$

This set, by virtue of Assumption 2 is a PC-set.

3) *Control Objective:* The objective is twofold: find a suitable sequence of triplets (x, v, u) depending on external renewable injections $d(k)$ for $k \in \{0, 1, \dots\}$ that minimizes the infinite horizon criteria

$$J(x_0, v_0, d) = \sum_{k=0}^{\infty} \ell_k(x(k), u(k), d(k)) \quad (11)$$

where ℓ_k is a time-varying stage cost comprising generation costs. And second, to derive a suitable stage cost $\ell_k(\cdot, \cdot)$ that captures energy pricing mechanisms allowing for maximum profit at each node in terms of the exogenous inputs (load consumption and renewable injection) and available battery storage.

III. PEER-2-PEER FRAMEWORK

A. OCP for energy system

To achieve our control objectives, consider the finite horizon criteria for each $i \in \mathcal{V}_I$ that employs exogenous predictions of Assumption 1:

$$J_i^N(\bar{z}_i, \mathbf{u}_i, \mathbf{d}_i) = \sum_{k=0}^{N-1} \underbrace{\gamma(x_i, v_i, u_i) + \lambda_{k,i}(y_i)}_{\ell_{k,i}(z_i, u_i, d_i)} \quad (12)$$

with $z_i = (x_i, v_i)$, the stage cost $\ell_{k,i}(z_i, u_i, d_i)$ is composed by two terms capturing the costs of operating each node, in terms of batteries and voltages, and time-varying term $\lambda_{k,i}(\cdot)$ reflecting the cost of energy transactions. The former penalises deviations from a reference voltage point and the

cost of operating the battery which depend on the power value and state of charge. The latter function is determined from the negotiation framework, see Section III-B; this function depends on the surplus or deficit power at each node. The performance criteria arguments are sequences of states $\mathbf{z}_i = \{z_i(0), \dots, z_i(N)\}$ and controls $\mathbf{u}_i = \{u_i(0), \dots, u_i(N-1)\}$. Both of these sequences depend on exogenous inputs $\mathbf{d}_i = \{d_i(0), \dots, d_i(N-1)\}$; each $d_i(k)$ comprises predicted renewable injections $\{w_{h,i}(k)\}_{h \in \mathcal{H}}$, load consumption $S_{l,i}(k)$, and neighboring voltages $\{v_j(k)\}_{j \in \mathcal{N}_i}$. The resulting optimal control problem for each node for $\bar{z}_i = (\bar{x}_i, \bar{v}_i)$ and available predictions \mathbf{d}_i is

$$\mathbb{P}_i(\bar{z}_i, \mathbf{d}_i): \min\{J_i^N(\bar{z}_i, \mathbf{u}_i, \mathbf{d}_i) : \mathbf{u}_i \in \mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i)\}. \quad (13)$$

The constraint set $\mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i)$ is defined by

$$(x_i(0), v_i(0)) = \bar{z}_i, \quad (14a)$$

$$x_{h,i}^+ = f_i(x_i, u_i, d_i), \quad (14b)$$

$$x_i \in \mathbb{X}_i, \quad u_i \in \mathbb{U}_i, \quad v_i \in \mathbb{V}_I(d_i), \quad (14c)$$

$$h_i(v_i, y_i) = \mathcal{L}_i v_i + \hat{\mathcal{L}}_i d_i. \quad (14d)$$

The prediction model (14b) differs from its counterpart (1)–(3) in the nature of the exogenous inputs used; the former employs sequences of forecasts while the later uses the “true” values. This optimization problem is subject to coupled constraints (14c) and (14d) with respect to network voltages. The set $\mathbb{V}_I(d_i)$ represents a “slice” of \mathbb{V}_I corresponding to node i for given fixed values of neighboring voltages; when coupled constraints are absent, *i.e.*, no bounds on line currents, the voltage constraint sets are independent from neighbouring information. The matrix $\hat{\mathcal{L}}_i$ maps d_i to the current balance for node i , *i.e.*, forming the i^{th} row of (8) representing the power flow for node i . The solution of $\mathbb{P}_i(\bar{z}_i, \mathbf{d}_i)$ is a sequence of optimal control inputs \mathbf{u}_i^0 . One feature of this formulation is the introduction of cooperation between the MG nodes; by sharing voltage information, each node i is implicitly aware of power fluctuations from its physical neighbours. Suppose at time k , each node i measures $z_i = (x_i, v_i)$, exchanges voltage prediction sequences, obtains forecasts for renewable injections and load demands such that $\mathbf{d}_i(k)$ is available; then applies the first element of the optimal solution \mathbf{u}_i^0 of (13) to the system. At the next sampling time, we discard the existing sequence, measure the plant, obtain new forecasts, then solve (13) with the updated information. This process is repeated *ad infinitum*. A standard Assumption on the stage cost for regularity purposes is

Assumption 4 (Positive definite stage cost). $\lambda_{i,k}: \mathbb{X}_i \times \mathbb{R}^2 \rightarrow \mathbb{R}$ and $\gamma_i: \mathbb{U}_i \times \mathbb{X}_i \rightarrow \mathbb{R}$ are, for each $i \in \mathcal{M}$ and $k \in \mathbb{N}$, continuous positive definite functions.

B. Market negotiation

We propose an agent based approach to handle the market layer involving negotiations to choose adequate pricing policies. The market layer of our approach aims to handle power deficits and surpluses at each node $i \in \mathcal{V}_I$. The time-varying component of the cost (12), $\lambda_{i,k}(\cdot)$, weighs this output power and is the tool used to interface both the energy trading scheme

and lower control levels. In our approach, we propose the use of a nonlinear pricing policy for exporting and importing power as opposed to the traditional linear pricing used in the literature [24]. This results in a negotiation framework where the participating nodes decide upon a policy which provides a mechanism to take predicted battery storage levels into account.

This negotiation framework can be interpreted as a game with a leader when the network is connected [25]. The set of players is given by $\mathcal{V}_I \cup \mathcal{V}_0$; the set of actions for each $i \in \mathcal{V}_I$ is the set of functions $\mathcal{A}_i = \{\lambda_i \in \mathcal{L}_2[\mathbb{Y}_i, \mathbb{R}] : \lambda_i(y_i) \geq 0\}$ with \mathbb{Y}_i the output constraint set which by Assumption 1 and 2 is compact. The action set for \mathcal{V}_0 is given by $\mathcal{A}_0 = \{(\lambda_{0,s}, \lambda_{0,b}) \in \mathbb{R}^2 : \eta_s \leq \lambda_{0,s} < b_{0,b} \leq \eta_b\}$ representing the cost of purchasing or selling power to the grid. These prices are upper and lower bounded by $\eta_s > 0$ and $\eta_b > 0$ respectively. The total average network revenue is³

$$R = \sum_{i \in \mathcal{V}_I} \frac{1}{\mu(\mathbb{Y}_i)} \int_{Y_i} \lambda_i \circ \sigma d\mu \quad (15)$$

where each pricing policy is averaged over a set $Y_i = (y_i + S_{b,i}^{\max}[-\text{SoC}_i, 1 - \text{SoC}_i]) \cap \mathbb{Y}_i$ reflecting the available power with respect to current storage levels SoC and μ is the Lebesgue measure for \mathbb{Y}_i . On the other hand, the power purchased by each $i \in \mathcal{V}_I$ acting as a buyer at a given time is

$$\xi_i(\lambda_i, \lambda_{-i}, y) = \frac{\lambda_i(-\sigma(-y_i))}{\sum_{j \in \mathcal{N}_i^{\text{com}} \cup \{i\}} \lambda_j(-\sigma(-y_j))} \sum_{j \in \mathcal{N}_i^{\text{com}} \cup \{i\}} \sigma(y_j) \quad (16)$$

which depends on neighbouring output power $y = (y_1, \dots, y_{|\mathcal{V}_I|})$; it is worth noting that the only information needed to compute (16) is that of the trading neighbours. Each node behaves as a prosumer and it has attached to it a utility functional $r_i : \mathcal{A}_i \times \mathcal{A}_{-i} \rightarrow \mathbb{R}$, which depends on grid purchasing price b_i and predictions of storage and output power, defined as

$$r_i(\lambda_i, \lambda_{-i}) = \sum_{k=0}^{N-1} \left(\lambda_{0,b} \xi_i(\lambda_i, \lambda_{-i}, y(k)) - \lambda_i(\xi_i(\lambda_i, \lambda_{-i}, y(k))) + \log\left(1 + \frac{\sigma(y_i(k))}{S_{b,i}^{\max}}\right) + \gamma_i R(k) \frac{\sigma(y_i(k))}{1 + \sum_{i \in \mathcal{V}_I} \sigma(y_i(k))} \right). \quad (17)$$

This utility functional measures revenue and satisfaction of each node with its current pricing policy, see [26] and [24]. There are two prominent parts: the first two terms represent the cost of purchasing with respect to the price set by the utility grid $\lambda_{0,b} > 0$ which the agent seeks to minimise; the remaining terms correspond to the advantages of selling surplus power, the effect of available storage, and trade-off between increasing prices and loss of revenue. The choice of a logarithmic function represents a law of diminishing returns. The function $\sigma(\cdot)$ is a key component of this cost, depending

³The function $\sigma(x) = \frac{x e^{\alpha x}}{e^{\alpha x} + 1}$ for a fixed $\alpha > 0$ is a smooth approximation of $\max(0, x)$. As $\alpha \rightarrow \infty$, $\sigma(\cdot) \rightarrow \max(0, \cdot)$.

on the output power sign, two terms will vanish implying that each node is either maximising profit or minimising costs but never both. This formulation avoids unwanted saddle or conservative behaviour when optimising. This approach induces a time-varying partition of \mathcal{V}_I into two disjoint sets of sellers $\mathcal{V}_{I,S}$ when $y_i > 0$, and buyers $\mathcal{V}_{I,B}$ for $y_i < 0$.

The set $\mathcal{A}_{-i} \triangleq \prod_{j \in \mathcal{N}_i^{\text{com}}} \mathcal{A}_j$ collects the actions of the neighbours in the communication network which are used to compute the total revenue $R(k)$ known by the utility grid, characterises the negotiation framework communication properties, and is defined as an unweighted graph characterised by a set of edges $\mathcal{E}^{\text{com}} \subset \mathcal{V} \times \mathcal{V}$ which generates a set of neighbours $\mathcal{N}_i^{\text{com}} \subset \mathcal{V}$ similar to (5). The particularity of this network is that for all $i \in \mathcal{V}_I$, the utility grid, if present, satisfies $0 \in \mathcal{N}_i$ implying each negotiating prosumer can communicate with the utility grid; this condition is necessary since the utility grid agent determines the upper and lower bounds on electricity prices. The utility grid solves the following optimisation problem with equilibrium constraints:

$$\mathbb{P}_0^{\text{com}} : \max_{\lambda_0 \in \mathcal{A}_0} \{r_0(\lambda_0, \lambda_{-0}) : \lambda_{-0} \in \prod_{j \in \mathcal{N}_0} \mathcal{R}_j(\lambda_{-j})\} \quad (18)$$

where the best reply map associated with λ_{-j} is $\mathcal{R}_j(\lambda_{-j}) = \{\lambda_j \in \mathcal{A}_j : r_j(\lambda_j, \lambda_{-j}) \leq r_j(\tilde{\lambda}_j, \lambda_{-j}), \forall \tilde{\lambda}_j \in \mathcal{A}_j\}$. The associated utility functional is

$$r_0(\lambda_0, \lambda_{-0}) = \lambda_{0,s} \sum_{i \in \mathcal{V}_I} \sigma(y_i) + \lambda_{0,b} \sum_{i \in \mathcal{V}_I} \sigma(-y_i) - \sum_{i \in \mathcal{V}_I} \lambda_i(\sigma(y_i))$$

In this way, the utility grid agent sets the price according to the best response of the network members given by \mathcal{V}_I . Similarly, for each $i \in \mathcal{V}_I$ the corresponding optimisation problem is

$$\mathbb{P}_i^{\text{com}}(\lambda_{-j}) : \max_{\lambda_i \in \mathcal{A}_i} r_i(\lambda_i, \lambda_{-i}) \quad (19)$$

An important feature of the presented approach and its relation to P2P platforms lies in the way the revenue of energy transactions is obtained. After the agents are split into groups of buyers and sellers, the total revenue gained from a transaction is shared among the agents selling power. A method to establish direct contracts or bilateral negotiation schemes is the subject of ongoing research.

Tractable reformulation: The negotiation framework as stated in the previous section may be prohibitively difficult to solve. The action spaces for each $i \in \mathcal{V}_I$ are infinite dimensional spaces, and to exacerbate the problem, the optimisation problem (18) has equilibrium constraints. We propose a method to simplify this problem to make it computationally tractable for both utility and network elements. Our first step towards this goal is to invoke the following:

Assumption 5. *Each node updates its pricing policy with a period $k_n \in \mathbb{N}$; the utility grid updates prices every $Hk_n \in \mathbb{N}$ for some $H \gg 0$.*

This Assumption may refer to the common practice of setting a day ahead price based on existing consumption and is common in leader-follower games as mentioned in [27].

Furthermore, Assumption 5 ensures that the utility grid is able to react only to the best replies from each network element.

Another potential bottleneck, from an implementation point of view, is that of the action space infinite dimensionality $\mathcal{A}_i \subseteq \mathcal{L}_2[\mathbb{Y}_i, \mathbb{R}]$. To overcome this hurdle, we propose to reduce the action space to a class of parameterised functions. The starting point is the traditional linear pricing policies, *i.e.*, $-\lambda_{0,b}y_i$ and $\lambda_{0,s}y_i$ for purchase and sale respectively. From Assumption 2, the output power is constrained to a bounded set. We seek a piece-wise smooth such that $\lambda_i(-y_i^{\max}) = \lambda_{0,b}y_i^{\max}$, $\lambda_i(0) = 0$, and $\lambda_i(y_i^{\max}) = \lambda_{0,b}y_i^{\max}$. Clearly, it is always possible to find a quadratic function fitting the positive part, and another fitting the negative one. The parameter we introduce is the deviation from a linear pricing: a way to measure this is to consider the area in between curves such that b_i is

$$\int_0^{y_i^{\max}} \lambda_{0,s}y_i dy - \int_0^{y_i^{\max}} \lambda_i dy = \int_{-y_i^{\max}}^0 -\lambda_{0,b}y_i dy - \int_{-y_i^{\max}}^0 \lambda_i dy.$$

Solving the above conditions yield the desired parameterised piece-wise smooth convex parameterisation. The missing ingredient is to satisfy Assumption 4. This can be done by suitably constraining the available values for $b_i \in [0, b_i^{\max}]$ such that $\lambda_i(y_i, b_i^{\max}) \geq 0$ for all $y_i \in \mathbb{Y}_i$. This allows us to assign a mapping between real positive numbers and \mathcal{A}_i such that $b_i \mapsto \lambda_i(\cdot)$. Injectivity of this map follows naturally from construction; surjectivity, however, is not ensured since the image of the real numbers is not \mathcal{A}_i but only a strict subset. This discrepancy is because of the inequality condition used to parameterise desired positive definite functions. In this way and owing to the continuity of $b \mapsto \lambda_i(\cdot)$, the problem of optimising over function spaces is reduced to optimising over $\mathbb{R}^{|\mathcal{V}_I|}$.

Following Assumption 5, the game can be played in two stages. The initialisation part corresponds to the utility grid agent choosing $\lambda_0 = (\eta_s, \eta_b)$. Then sequentially, following a best reply type updating, each node agent updates its desired pricing policy until they reach an equilibrium. This negotiation process occurs every k_n steps and takes into account the availability of both power forecasts for renewable sources and storage predictions at the given sampling time; the utility grid updates their prices $H * k_n$ steps for $H \geq 0$. The utility grid updates its decision variables in response to optimal pricing profiles obtained by network agents. The negotiation between network and utility grid agents occurs on top of the control layer described in Section III-A.

IV. CONVERGENCE ANALYSIS

In this section, we analyse the theoretical properties of the proposed pricing approach. We divide our analysis into two main parts: market negotiation convergence, and recursive feasibility. We finish this Section with remarks on how both market and control layers interact.

A. Negotiation Convergence

In this section, we study the convergence properties of the game $(\mathcal{V}_I, \{\mathcal{A}_i\}_{i \in \mathcal{V}_I}, \{r_i\}_{i \in \mathcal{V}_I})$ in the sense of Stackelberg. The outcome of this game will define the pricing policy used

by each element $i \in \mathcal{V}_I$. We begin this part of the analysis by defining the equilibrium concepts that will be used:

Definition 1 (Nash equilibrium). *An action profile $\lambda^0 = (\lambda_1^0, \dots, \lambda_{|\mathcal{V}_I|}^0)$ is said to be a Nash equilibrium of the game $(\mathcal{V}_I, \{\mathcal{A}_i\}_{i \in \mathcal{V}_I}, \{r_i\}_{i \in \mathcal{V}_I})$ if, for all $i \in \mathcal{V}_I$,*

$$r_i(\lambda_i^0, \lambda_{-i}^0) = \min_{\lambda_i \in \mathcal{A}_i} r_i(\lambda_i, \lambda_{-i}^0). \quad (20)$$

The set of Nash equilibrium points for \mathcal{V}_I parameterised by $\lambda_0 \in \mathcal{A}_0$ are $\mathbb{NE}(\lambda_0) \subset \prod_{i \in \mathcal{V}_I} \mathcal{A}_i$, this set represents the best network response to the prices set by the utility grid. This concept leads us to the other equilibrium concept we leverage on:

Definition 2 (Stackelberg equilibrium). *An action profile $\lambda^* = (\lambda_0^*, \dots, \lambda_M^*)$ is said to be an Stackelberg equilibrium of the 1 leader, M-follower game $(\mathcal{V}, \{\mathcal{A}_i\}_{i \in \mathcal{V}}, \{r_i\}_{i \in \mathcal{V}})$ if for all $i \in \mathcal{V}$*

$$\sup_{\lambda_{-0} \in \mathbb{NE}(\lambda_0^*)} r_i(\lambda_0^*, \lambda_{-0}) \leq \sup_{\lambda_{-0} \in \mathbb{NE}(\lambda_0)} r_i(\lambda_0, \lambda_{-0}) \quad (21)$$

The Stackelberg equilibrium complements that of the Nash equilibrium and essentially leads to an optimal response from the utility grid side in response to the best possible actions from the network side. Following Assumption 5, it is possible to solve these two problems independently with the caveat that it leads to a problem with equilibrium constraints, see [28] for an in-depth study of this type of problems. Given the utility functionals r_i naturally partition the set of nodes, it is possible without loss of generality to choose the buyer nodes to play first. Owing to the parameterisation of the pricing policy, $b_i \mapsto \lambda_i(\cdot)$, is convex by construction. Our first result considers the case when $y_i < 0$, *i.e.*, node i is purchasing power.

Lemma 1. *Suppose $y_i < 0$, then the purchased power in (16) is a concave function with respect $b_i \in [0, b_i^{\max}]$.*

Proof. By construction, $\forall i \in \mathcal{V}_I$ $\lambda_i(y_i, b_i) \geq 0$ and since the parameterisation is a linear problem, the policy is linear with respect to the parameter. Indeed, the conditions defined in Section IV-A for the negative part of the policy $\lambda_i(y_i) = a_2 y_i^2 + a_1 y_i$ are

$$\begin{aligned} a_2(y_i^{\max})^2 - a_1 y_i^{\max} &= \lambda_{0,b} y_i^{\max} \\ \frac{1}{2} \lambda_{0,b} (y_i^{\max})^2 + \frac{1}{3} a_2 (y_i^{\max})^3 + \frac{1}{2} a_1 (y_i^{\max})^2 &= b_i \end{aligned}$$

This yields a policy

$$\lambda_i(y_i, b_i) = \frac{6b_i}{(y_i^{\max})^3} y_i^2 + \frac{6b_i - \lambda_{0,b} (y_i^{\max})^2}{(y_i^{\max})^2} y_i.$$

This implies that the policy is concave on b_i . To prove the purchased power concavity, it is enough to check its derivatives. A direct calculation shows that

$$\frac{\partial^2 \xi_i}{\partial b_i^2} = -2 \frac{\sum_l \sigma(y_l) \sum_{l \neq i} \lambda_l(y_l, b_l) \left(\frac{\partial \lambda_i}{\partial b_i} \right)^2}{\left(\sum_{j \in \mathcal{N}_i^{\text{com}} \cup \{i\}} \lambda_j(y_j) \right)^3} < 0$$

is negative definite. \square

Lemma 2. *Suppose $b_i \in [0, b_i^{\max}]$ for all $i \in \mathcal{V}_I$, then $r_i(\lambda_i, \lambda_{-i})$ is a concave function with respect to b_i and b_{-i} .*

Proof. The proof proceeds by cases: *i*) $y_i \geq 0$. In this case, the first two terms of $r_i(\cdot, \cdot)$ vanish. The total revenue is by construction a linear function of b_i and b_{-i} and the logarithmic term is concave with respect to its domain. The resulting function which is a sum of concave functions is therefore concave.

ii) $y_i < 0$. In this case only the first two terms of $r_i(\cdot, \cdot)$ contribute, the later vanish. Following Lemma 1, the purchased energy is a concave function of b_i . The argument follows, *mutatis mutandis*, that of Lemma 1 to obtain the negativity of the second derivative within the range $[0, b_i^{\max}]$. \square

These two Lemmas lead to our first result, the proof of which follows from an application of [29, Theorem 4.3]

Theorem 3 (Network Nash equilibrium). *The game $(\mathcal{V}_I, \{\mathcal{A}_i\}_{i \in \mathcal{V}_I}, \{r_i\}_{i \in \mathcal{V}_I})$ admits a Nash equilibrium.*

Therefore Theorem 3 guarantees the existing of an optimal piece-wise smooth pricing policy that is dependent on the prices set by the utility grid. The move played by the grid satisfies $\lambda_0^0 = \arg \max r_0(\lambda_0, \lambda_{-0})$ which is by construction a linear problem over a compact set. A consequence of this fact is the existence of a Stackelberg equilibrium between network and utility grid. In summary, the solution of the bi-level optimisation problem (18) and (19) follows an algorithmic procedure. First, initial utility $\lambda_0(0)$ prices are given; the followers, *i.e.*, the elements of \mathcal{V}_I , solve their optimisation problems to find a Nash equilibrium. Once this equilibrium is achieved, the utility grid responds to it by setting new prices for the new iteration $\lambda_0(1)$ and the process repeats until convergence. This approach to pricing guarantees that all $i \in \mathcal{V}_I$ price their energy in an optimal way according to their own available power, in terms of storage, and information from its neighbours.

B. Recursive feasibility

From Assumption 1 and 3, the exogenous information available to the controller is contained within a PC-set $d_i(k) \in \mathbb{D}_i$ for all $k \geq 0$. The set $\mathcal{D}_i^N = \prod_{k=0}^{N-1} \mathbb{D}_i$ contains all sequences of length N . The challenge arises as a consequence of the receding horizon implementation of the control action: if $\mathbb{P}_i(z_i, \mathbf{d}_i)$ is feasible and yields a solution sequence $\mathbf{u}_i^0(z_i, \mathbf{d}_i)$, then its first element, which defines an implicit control law $\kappa_i^N(z_i, \mathbf{d}_i) = u_i^0(0; z_i, \mathbf{d}_i)$, is applied to the system resulting in the state evolution $z^+ = (x_i^+, v_i^+)$ obtained as a solution of the difference algebraic model (1), (2), and (6). At this sampling instant a new sequence of information is available to the controller, *i.e.*, $\mathbf{d}_i^+ \in \mathcal{D}_i^N$, and the problem to be solved is now $\mathbb{P}_i(z_i^+, \mathbf{d}_i^+)$. In this Section, we seek an answer to the question: What are the conditions necessary to ensure $\mathbb{P}_i(z_i^+, \mathbf{d}_i^+)$ has a solution when \mathbf{d}_i changes (perhaps arbitrarily) to \mathbf{d}_i^+ ?

We begin by defining *recursive feasibility*, and some useful terminology in the analysis:

Definition 3 (Recursive feasibility). *For each $i \in \mathcal{V}$, the OCP $\mathbb{P}_i(z_i, \mathbf{d}_i)$ is said to be recursively feasible if $\mathcal{U}_i^N(z_i, \mathbf{d}_i) \neq \emptyset$, then for a successor state $z_i^+ = (x_i^+, v_i^+)$, and $\mathbf{d}_i^+ \in \mathcal{D}_i^N$, the constraint set $\mathcal{U}_i^N(z_i^+, \mathbf{d}_i^+) \neq \emptyset$.*

For a disturbance sequence at time k , $\mathbf{d}_i = \{d_i(0), \dots, d_i(N-1)\}$, its associated \tilde{k}^{th} tail for time $k+1$ is $\tilde{d}_k(\mathbf{d}_i) = \{d_i(1) \dots, d_i(\tilde{k}-1), d_i(\tilde{k}), \dots, d_i(N-1)\}$. It is clear that both \mathbf{d}_i and $\tilde{d}_k(\mathbf{d}_i)$ belong to the set \mathbb{D}_i ; the notion of the tail allows us to quantify the change in information that a controller is subject to, for two sequences $\mathbf{d}, \mathbf{e} \in \mathcal{D}_i^N$, the distance $\rho(\mathbf{d}, \mathbf{e}) = |\tilde{d}(\mathbf{d}) - \mathbf{e}|$ is a metric on the sequence space \mathcal{D}_i^N .

A system is said to be locally controllable at a point $z_0 \in Z_0$ if for every $\varepsilon > 0$, $H \in \mathbb{N}$ and \bar{z} such that $|z - z_0| \leq \varepsilon$, there exists a finite sequence of controls $\{u(0), \dots, u(H-1)\}$ such that its solution satisfies $|z(k) - z_0| < \varepsilon$ for all $j \in \mathbb{N}_{0:H-1}$ with $z(0) = z_0$ and $z(H) = \bar{z}$. The set of feasible states is $\mathcal{Z}_i^N(\mathbf{d}_i) = \{z_i : \mathcal{U}_i^N(z_i, \mathbf{d}_i) \neq \emptyset\}$ defines the region in the state space such that the OCP is feasible. The first of our results is concerned when the exogenous information is unchanging, *i.e.*, the future information is taken to be the tail of the initial sequence.

Theorem 4. *Let $\mathbf{d}_i \in \mathcal{D}_i^N$ and suppose each node is locally controllable with respect to \mathbf{d}_i . If $\mathbf{d}_i^+ = \tilde{d}_k(\mathbf{d}_i)$, then $(x_i, v_i) \in \mathcal{Z}_i^N(\mathbf{d}_i)$ implies $(x_i^+, v_i^+) \in \mathcal{Z}_i^N(\mathbf{d}_i^+)$.*

Proof. Given $(x_i, v_i) \in \mathcal{Z}_i^N(\mathbf{d}_i)$, then an optimal sequence of control actions $\mathbf{u}_i^0(z_i, \mathbf{d}_i) = \{u_i^0(0; z_i, \mathbf{d}_i), u_i^0(1; z_i, \mathbf{d}_i), \dots, u_i^0(N-1; z_i, \mathbf{d}_i)\}$ exists and generates a sequence of states and voltages $\mathbf{x}_i^0 = \{x_i^0(0), \dots, x_i^0(N)\}$ and $\mathbf{v}_i^0 = \{v_i^0(0), \dots, v_i^0(N-1)\}$ for a given information $\mathbf{d}_i \in \mathcal{D}_i^N$. Now, we construct a sequence of control actions $\tilde{\mathbf{u}}_i = \{\tilde{u}_i(0), \dots, \tilde{u}_i(N-1)\} \in \mathcal{U}_i^N(z_i^+, \mathbf{d}_i^+)$. Using the definition of a disturbance tail, the first k elements of \mathbf{d}_i^+ satisfy $\mathbf{d}_i^+(k) = \mathbf{d}_i(k+1)$ implying that $\tilde{\mathbf{u}}_i(k) = u_i^0(k+1; z_i, \mathbf{d}_i)$ for all $k \in \{0, \dots, k-1\}$. The state evolution is governed by a set of difference algebraic equations $F_i(z_i, u_i, d_i, z_i^+) = 0$ composed of \mathcal{C}^1 dynamics (1)–(3) and (8). Using the implicit function theorem, it is possible to locally define a function $\xi_V(\cdot, \cdot, \cdot)$ such that $z_i^+ = \xi_V(z_i, u_i, d_i)$ and ensure the existence of neighbourhoods V and Z such that for $(z_i, u_i, d_i) \in V$, $(z_i, u_i, d_i, \xi_V(z_i, u_i, d_i)) \in Z$ and $F_i(z_i, u_i, d_i, \xi_V(z_i, u_i, d_i)) = 0$. Consider the initial state to be $\tilde{z}_i(0) = (x_i^0(1), v_i^0(1))$, the subsequent states, following ξ_V , satisfy $\tilde{z}_i(k) = (x_i^0(k+1), v_i^0(k+1))$ for all $k \in \{0, \dots, k\}$. The next element satisfies $\tilde{z}_i(k+1) = \xi_V(\tilde{z}_i(k), \tilde{u}_i, d_i(k))$ for some $\tilde{u}_i \in \mathcal{U}_i$. Since each node is locally controllable with respect to \mathbf{d}_i , there exists a control action $\tilde{u}_i \in \mathcal{U}_i$ such that $\xi_V(z_i, \tilde{u}_i, d_i) \in \mathbb{X}_i \times \mathbb{V}_I(d_i)$. Similarly, there exists a control law $\hat{u} \in \mathcal{U}_i$ such that $\tilde{z}_i(k+2) = z_i^0(k+2) = \xi_V(z_i(k+1), \hat{u}, d_i(k+1))$. The resulting sequence satisfies

$$\begin{aligned} \tilde{\mathbf{u}}_i = & \{u_i^0(1), \dots, u_i^0(k), \tilde{u}_i, \\ & \hat{u}_i, u_i^0(k+2), \dots, u_i^0(N-1)\} \in \mathcal{U}(z_i^+, \mathbf{d}_i^+). \end{aligned}$$

\square

Once recursive feasibility of the tail is achieved, we allow the information to vary (perhaps arbitrarily). To study this case, we turn to the continuity properties of both value function

and constraints which depend on exogenous inputs and initial states. The set

$$\Gamma_i^N = \{(z_i, \mathbf{d}_i) : z_i \in \mathcal{Z}_i^N(\mathbf{d}_i), \mathbf{d}_i \in \mathcal{D}_i^N\}$$

is the graph $\text{gr } \mathcal{Z}_i^N$ of the set-valued map corresponding to the feasible set $\mathcal{Z}_i^N : \mathcal{D}_i^N \rightarrow 2^{\mathbb{X}_i}$.

Definition 4 (Upper semicontinuity for set-valued maps). *A set $\Phi : U \rightarrow 2^X$ is upper semicontinuous at $\xi_0 \in U$ if for an open neighbourhood $V_U \subset U$ of ξ_0 , then for all $\xi \in V_U$ $\Phi(\xi) \subset V_X$ for an open neighbourhood $V_X \subset X$.*

Proposition 1. *Suppose Assumption 1– 4 hold and the dynamics are continuous. Then the set valued map $\mathcal{Z}_I^N(\cdot)$ is upper semicontinuous.*

Proof. The constraints given by (14), by Assumptions 2 and 3 together with the continuity of each node's dynamics, have a structure $\mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i) = \{\mathbf{u}_i : G_i(\mathbf{u}_i, \bar{z}_i, \mathbf{d}_i) \in \mathbb{K}\}$ for a fixed compact set \mathbb{K} and a continuous function $G(\cdot, \cdot, \cdot)$. This implies that the graph of $\mathcal{U}_i^N(\cdot, \cdot)$ is a compact set; since the underlying space is finite dimensional, there is a compact neighbourhood V_Φ such that $\text{gr } \mathcal{U}_i^N \subset V_\Phi$. If the set Γ_i^N is closed and $\mathbb{X}_i \times \mathbb{V}_I(\mathbf{d}_i)$ is compact then by [30, Lemma 4.3] our result follows. Consider a converging sequence $\{\bar{z}_{i,k}, \mathbf{d}_{i,k}\} \subset \Gamma_i^N$; to prove our result, we need to ensure that the limit point $(\bar{z}_i, \mathbf{d}_i)$ belongs to Γ_i^N . Using the definition of Γ_i^N , there exists $\mathbf{u}_{i,k}$ such that $G_i(\mathbf{u}_{i,k}, \bar{z}_{i,k}, \mathbf{d}_{i,k}) \in \mathbb{K}$ which by continuity of $G_i(\cdot, \cdot, \cdot)$ yields $\mathbf{u}_{i,k} \rightarrow \bar{\mathbf{u}}_i$ and $G_i(\bar{z}_i, \bar{\mathbf{u}}_i, \mathbf{d}_i) \in \mathbb{K}$. The closedness of Γ_i^N follows. \square

The feasible map $\mathcal{Z}_i^N(\cdot)$ is the domain of the constraint map $\mathcal{U}_i^N(\cdot)$. The proof of proposition 1 shows the close relation between the set defining constraints and the feasible region; moreover, this results implicitly states that for small deviation in the exogenous inputs \mathbf{d}_i , the resulting optimisation problems associated to the feasible sets have a solution.

The following result builds on the previous ones:

Proposition 2 (Value function continuity). *Suppose Assumption 1– 4 hold, $f_i(\cdot)$ and $h_i(\cdot)$ are continuous, and the set of optimisers of $\mathbb{P}_i^N(\bar{z}_i, \mathbf{d}_i)$ is compact. Then the value function*

$$\nu_i^{N,0}(\bar{z}, \mathbf{d}_i) = \min\{J_i^N(\bar{x}_i, \mathbf{u}_i, \mathbf{d}_i) : \mathbf{u}_i^N \in \mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i)\} \quad (22)$$

is continuous.

Proof. The proof is an adaptation of [30, Proposition 4.4] to our setting. The continuity of the value function depends on the upper semicontinuity of the constraint set, which holds by Proposition 1, and the existence of neighbourhoods of the set of optimisers of (13), which is guaranteed since these form a compact set by assumption. The compactness implies that there exists a finite open covering of $\{(\bar{z}_i, \mathbf{d}_i)\} \times \mathcal{S}(\bar{z}_i, \mathbf{d}_i) \subset V_{Z'} \times V_U$, where $\mathcal{S}(\bar{z}_i, \mathbf{d}_i) = \arg \min\{J_i^N(\bar{x}_i, \mathbf{u}_i, \mathbf{d}_i) : \mathbf{u}_i^N \in \mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i)\}$. In this neighbourhood, the ‘‘almost’’ optimal points that satisfy $J_i(\bar{x}_i, \mathbf{u}_i, \tilde{\mathbf{d}}_i) \leq \nu_i^{N,0}(\bar{z}_i, \mathbf{d}_i) + \varepsilon$ for all $(\tilde{z}, \tilde{\mathbf{d}}_i, \mathbf{u}_i) \in V_{Z'} \times V_U$. Since the neighbourhood V_U contains an optimal point which belongs to a closed set, the intersection $V_U \cap \mathcal{U}_i^N(\bar{z}_i, \tilde{\mathbf{d}}_i) \neq \emptyset$ which yields: $\nu_i^{N,0}(\bar{z}_i, \tilde{\mathbf{d}}_i) \leq \nu_i^{N,0}(\bar{z}_i, \mathbf{d}_i) + \varepsilon$.

On the other hand, $\nu_i^{N,0}(\bar{z}_i, \mathbf{d}_i) - \varepsilon \leq J_i(\bar{x}_i, \mathbf{u}_i, \mathbf{d}_i)$ holds for all $\mathbf{u}_i \in \mathcal{U}_i^N(\bar{z}_i, \mathbf{d}_i)$. From the proof of Proposition 1, the

set $\mathcal{U}_i^N(\cdot, \cdot)$ is upper semicontinuous and there exists neighbourhoods $V_{U'}$ and $V_{Z'}$ such that for all $(\tilde{z}_i, \tilde{\mathbf{d}}_i) \in V_{Z'}$ and $\mathbf{u}_i \in V_{U'} \cap \mathcal{U}_i^N(\tilde{z}_i, \tilde{\mathbf{d}}_i)$, $\nu_i^{N,0}(\tilde{z}_i, \mathbf{d}_i) - \varepsilon \leq J_i(\tilde{x}_i, \tilde{\mathbf{u}}_i, \tilde{\mathbf{d}}_i)$ holds. Since $\varepsilon > 0$ is arbitrary, then $\nu_i^{N,0}(\tilde{z}_i, \mathbf{d}_i) - \varepsilon \leq \nu_i^{N,0}(\tilde{z}_i, \tilde{\mathbf{d}}_i)$. Continuity of $\nu_i^0(\cdot)$ follows. \square

The continuity of the value function is a crucial property for our objective. Consider a subset $\Omega_{i,\beta} = \{(z_i, \mathbf{d}_i) \in \Gamma_i^N : \nu_i^{N,0}((z_i, \mathbf{d}_i)) \leq \beta\}$ for $\beta > 0$.

Assumption 6. *The exogenous input sequence evolves as $\mathbf{d}_i^+ = \tilde{d}_k(\mathbf{d}_i) + \Delta \mathbf{d}_i$ where $\Delta \mathbf{d}_i = \mathbf{d}^+ - \tilde{d}_k(\mathbf{d}_i) \in \Delta \mathcal{D}_i^N$. The set $\Delta \mathcal{D}_i^N$ is chosen such that⁴ $\lambda_i = \text{diam}_{\mathcal{D}_i^N} \Delta \mathcal{D}_i^N$ satisfies*

$$\lambda_i \leq \sigma_{\nu_i}^{-1}((id - \gamma_i)(\alpha_i))$$

where γ_i is a \mathcal{K} -function, and $\alpha_i > 0$ such that $\Omega_{i,\alpha} \subset \Gamma_i^N$.

The overall dynamics for both states and disturbance satisfy

$$F_i(z_i, \kappa_i^N(z_i, \mathbf{d}_i), d_i, z_i^+) = 0 \quad (23a)$$

$$\mathbf{d}_i^+ \in \tilde{d}_k(\mathbf{d}_i) + \Delta \mathcal{D}_i^N \quad (23b)$$

We claim that a subset $\Omega_\rho \subset \Omega_\beta$ is a positive invariant set. The implications of this assertion is that the evolution of (23) is contained within one of this level sets. This is a nonlinear generalisation to the one presented in [31].

Theorem 5. *Suppose Assumptions 1– 4, 6 hold and for all $i \in \mathcal{V}_I$ $(z_i(0)\mathbf{d}_i(0)) \in \Omega_{i,\beta} \subset \Gamma_i^N$ for some $\beta \geq \alpha$. The set $\Omega_{i,\beta}$ is positively invariant for the composite system (23).*

Proof. Consider $(z_i, \mathbf{d}_i) \in \Omega_{i,\beta}$, from Theorem 4, the optimisation problem remains feasible when the available exogenous sequence assumes the k^{th} -tail. Following classical results from the MPC literature, feasibility of the optimisation problem implies stability. A consequence of this is that the value function is a Lyapunov function, i.e., $\nu_i^{N,0}(z_i^+, \tilde{d}_k(\mathbf{d}_i)) \leq \nu_i^{N,0}(z_i, \mathbf{d}_i) - \theta_{3,i}(|z_i|)$ and $\theta_{1,i}(|z_i|) \leq \nu_i^{N,0}(z_i, \mathbf{d}_i) \leq \theta_{2,i}(|z_i|)$ for some $\theta_{3,i}, \theta_{2,i}, \theta_{1,i} \in \mathcal{K}$. On the other hand, the continuity of $\nu_i^{N,0}$ over a compact set implies that is uniformly continuous on that set. From [32, Lemma 1], there exists a \mathcal{K}_∞ -function $\alpha \sigma_{\nu_i}$ such that

$$\nu_i^{N,0}(z_i^+, \mathbf{d}_i^+) \leq \nu_i^{N,0}(z_i, \mathbf{d}_i) - \theta_i(|z_i|) + \sigma_{\nu_i}(|\mathbf{d}_i^+ - \tilde{d}_k(\mathbf{d}_i)|)$$

Using Assumption 6, we obtain

$$\begin{aligned} \nu_i^{N,0}(z_i^+, \mathbf{d}_i^+) &\leq \nu_i^{N,0}(z_i, \mathbf{d}_i) - \theta_{3,i}(|z_i|) + (\rho_i - \gamma_i)(\alpha_i) \\ &\leq (id - \theta_{3,i} \circ \theta_{2,i}^{-1})\nu_i^{N,0}(z_i, \mathbf{d}_i) + (\rho_i - \gamma_i)(\beta_i) \\ &\leq (id - \theta_{3,i} \circ \theta_{2,i}^{-1})(\beta_i) + (\rho_i - \gamma_i)(\beta_i) \end{aligned}$$

Taking $\gamma_i = id - \theta_{3,i} \circ \theta_{2,i}^{-1}$ yields $\nu_i^{N,0}(z_i^+, \mathbf{d}_i^+) \leq \beta_i$ which implies that $(z_i^+, \mathbf{d}_i^+) \in \Omega_{i,\beta}$ \square

The main assertion of this section is a consequence of theorem 5.

⁴For a set $\mathcal{A} \subset \mathcal{B}$, its diameter with respect to \mathcal{B} is $\text{diam}_{\mathcal{B}} \mathcal{A} = \max\{|x - y| : x, y \in \mathcal{A}\}$.

Corollary 1 (Recursive Feasibility). *If $z_i(0) \in \{z_i: (z_i, \mathbf{d}_i) \in \Omega_{i,\beta}\} \subset \mathcal{Z}_i^N(\mathbf{d}_i)$, then $z_i(k) \in \mathcal{Z}_i^N(\mathbf{d}_i(k))$ provided the exogenous inputs update rate is limited.*

Recursive feasibility is obtained then as a consequence of the stability properties of the predictive controllers. The negotiation framework modifies the cost according to the change in exogenous inputs, a variation in load demand or renewable injection will result in a potential update in the pricing policy. If Assumption 6 holds, then the controller can handle variations in its cost criteria. On the other hand, the sources of potentially large variations arise from sudden load demands; renewable injections can be kept within prescribed variation using the available inputs Δ_i and local storage. This section established conditions to guarantee feasibility of the OCP with respect to changing forecasts. These conditions follow from regularity, see 1 and 2, of the optimisation problem which is robust to bounded variations of forecasts as shown in Theorem 5.

V. TESTING AND EVALUATION ENVIRONMENT

In this section, we illustrate the properties of the proposed combination of negotiation framework and distributed control. First we briefly introduce the method to obtain the predicted sequences \mathbf{d}_i ; we explore the coupled constraint satisfaction properties of our approach in a simplified example. Lastly, we apply the proposed approach to a MG with a meshed topology and analyse its performance according to its effects on power flows, voltages, pricing and overall costs.

A. Forecasting

Assumption 1 lays the foundations of the proposed approach; the distributed MPC controller at each time k has access to forecasts of generation and consumption of power along a finite horizon, *i.e.*, $\{d(k), d(k+1), \dots, d(k+N)\}$. In this section, we briefly discuss how we construct these exogenous inputs $d_i = (\{w_{h,i}\}_{h \in \mathcal{H}}, S_{L,i}) \in \mathbb{D}_i$ where \mathcal{H} denotes a set of the available renewable source, *i.e.*, wind, PV, etc. The requirement of N -step prediction sequences is in line with the seasonality of consumption and renewable injection; therefore the Seasonal Auto-Regressive Integrated Moving Average (ARIMA) represents a natural choice for forecasting. Initially introduced in [33], ARIMA is a well known forecasting method that uses linear combinations of past data $d_i(k-j)$ and errors $e_i(k-j)$ for $j \in \mathbb{N}$. These linear combinations are polynomials $T(\cdot)$ and $S(\cdot)$ of degree p and q with respect to the backward shifting operator, *i.e.*, $\Delta^j d(k) = d(k-j)$. The prediction and forecasting error relation at time k is $T(\Delta)d_i(k) = S(\Delta)e_i(k)$ with $T(\Delta)$ containing factors of $(1-\Delta)^d$. The numbers (p, d, q) completely characterise this method. The Seasonal ARIMA (SARIMA) employs the operator $\Delta_D d_i(k) = d_i(k-D)$, then the forecasting model uses $\hat{T} = T(\Delta_D)$ and $\hat{S} = S(\Delta_D)$.

Both ARIMA and SARIMA are commonly applied time-series based statistical models with low processing requirements as compared to deep neural networks models. The work in [34] shows that even without considering social and environmental factors SARIMA can achieve an Average Mean Percentage Error (AMAPE) of 9.44% on load forecasting with a 72h time-frame. Due to the lack of daily or weekly seasonality in

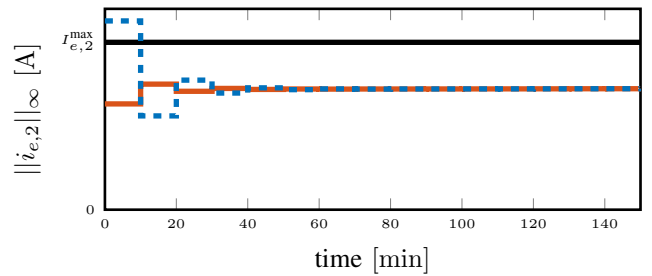


Fig. 3. Normalised line current norm $\|i_{e,2}\|_{\infty}$ for a system with coupled constraints (—) and the system without line current constraints (---). The upper bound (—) is $I_{e,2}^{\max} = 35\text{A}$.

wind turbine generation ARIMA models are more suitable for forecasting, with the work in [35] showing a forecast accuracy for the square root of the Mean Square Error (\sqrt{MSE}) of 11.87% with a 48h forecast window. For our testing data, the selected models for each component together with their Akaike information criterion (AIC) and Normalised Root Mean Square Error (NRMSE) are shown in Table I. The AIC value is based on training the models across all the scenarios and the NRMSE value is the average across all the scenarios when applied daily as a 24h forecast.

B. Voltage constraints

To visualise the constraint satisfaction properties, we consider initially a simplified example that comprises a network with $\mathcal{V} = \{0, 1, 2\}$ and $\mathcal{E} = \{(0, 1), (1, 2)\}$. The voltage at each node $v_i = (v_{d,i}, v_{q,i}) \in \mathbb{R}^2$ is constrained to a set $\mathbb{V}_i = \{v_i: |v_i|^2 \leq 230\sqrt{2} \wedge v_{d,i} \geq 205\sqrt{2}\}$ satisfying Assumption 3. In addition, we consider line constraints on $e_2 = (1, 2)$ such that $\mathbb{I}_E = \{(i_{e,1}, i_{e,2}): |i_{e,2}|_{\infty} \leq 35\}$. Following the discussion of Section II-A2, these line constraints induce voltage constraints as shown in (10). The geometry of these constraints is hard to visualise since $\mathbb{V}_I \subset \mathbb{R}^4$; the only available visualisations are merely projection which may lose information. To visualise the effect of these constraints, we focus on the line currents which are computed explicitly as

$$i_E = Y_E(\mathcal{B}_I v_I + \mathcal{B}_0(\mathcal{L}_0 + Z_0^{-1})(Z_0^{-1}E_0 - \mathcal{B}_0^T Y_E \mathcal{B}_I v_I))$$

The network is initialised at $v_1(0) = (315.1, -67.31)$ and $v_2 = (323.6, -13.7)$ such that $(v_1(0), v_2(0)) \in \mathbb{V}_I$. In Figure 3, we show the behaviour of the line currents with and without these constraints when subject to the same load demand and renewable input. The response that does not contain these coupled constraints shows more aggressive towards the a steady state value; on the other hand the proposed approach is more conservative in the transient but achieves the same result in steady state. Although a simplified network is considered

TABLE I
TRAINING PARAMETERS AND ACCURACY OF FORECASTING MODELS AS APPLIED TO THE TESTING SCENARIOS

Parameter	Model Type	Parameters (p,d,q)(P,D,Q)	AIC	NRMSE
Consumption	SARIMA	(1,1,1)(0,1,1)	349.5	12.0%
WT Generation	ARIMA	(2,0,1)	4344.9	23.3%
PV Generation	SARIMA	(1,1,2)(0,2,2)	2177.1	12.4%

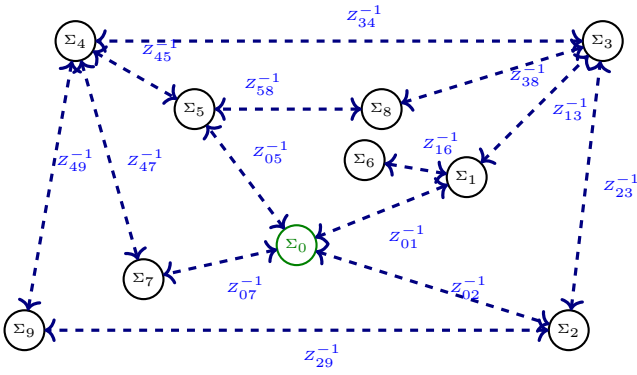


Fig. 4. Topology of the proposed network in Section V-C. The utility grid is represented by Σ_0 and each Σ_i is a node comprising renewable sources and loads.

here for better visualisation of the methods and results, our methodology can easily be extended to more complicated networks in a straightforward manner as seen in the next section.

C. Data Sources and Scenario Generation

In this section, we analyse the performance of the proposed algorithm that combines the distributed MPC controller and market layer subject to different methods of forecasting. Our study considers scenarios that cover a wide range of DER configurations and renewable inputs. For the wind turbine data, the scenarios were generated based on the data collected in [36] from real turbines in South Wales, UK. The data for PV panels is generated following a Clear-sky models and a burr distribution noise for Sheffield, UK. The consumption data is based on a data-set from [37]. The primary parameter that is iterated through is the time of year which varies between [Summer, Spring/Autumn, Summer]. This influences the week selection in the PV panels and sets the week for the consumption and wind turbine as well. The size of the panels varies between [15.4m², 45.6m², 85.2m²]. The wind turbine selects a value in the time of the year that matches one of the 4 identified patterns in the data. The battery sizes vary between [5kWh, 13.5kWh, 25kWh]. The number of units in each scenario vary between [3, 6, 9]; all of these nodes are connected through a physical network, see Figure 4. The combination of the resulting 447 units into 74 scenarios with all of them running for a week enables us evaluate the influence of the various forecasting methods and their effects on power balance, voltages, pricing and overall costs.

D. Scenario Evaluation and Results

The variation of the prices and cost that an individual DER Unit received based on the type of forecast that was used can be seen in Figure 5, where the top figures shows how the lack of forecasting will result in the unit needing to purchase energy at peak consumption times, while in the case of an existing forecast, these peaks can be predicted and energy can be bought more consistently. The lack of forecasting also influences the energy price in the scenario as unforeseen demand can increase the price of available energy.

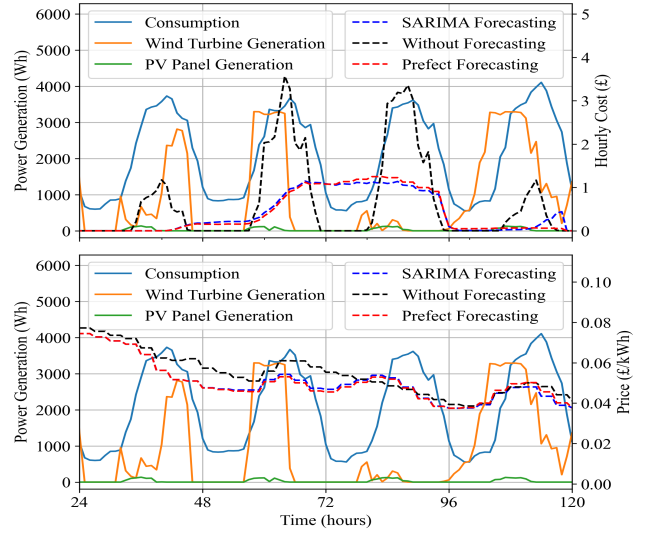


Fig. 5. The effects of forecasting on the energy cost and price when considering a Single DER given a set consumption and generation pattern.

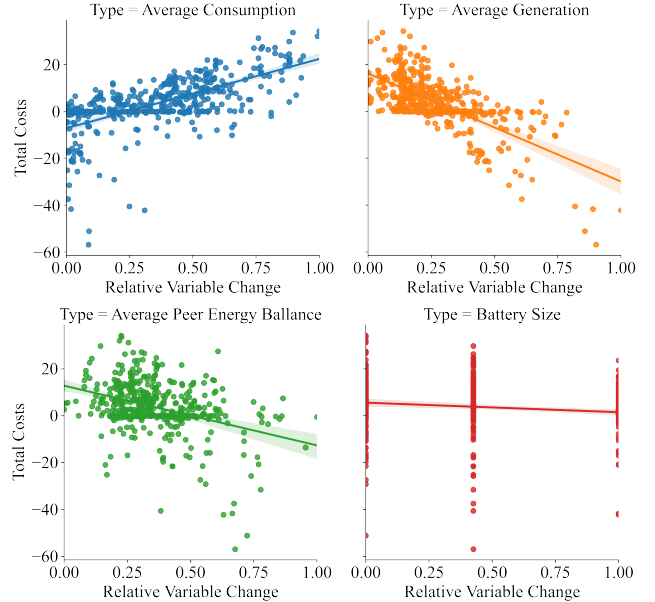


Fig. 6. Variation in Total Cost over the 7 day period for each individual unit based on normalised parameter values. The trends for each are highlighted using a linear regression approximation.

The variation of overall costs for each unit in all the scenarios as compared to the their generation, consumption, average peer energy balance and battery size can be seen in Figure 6. The first two figures show the change of overall costs based on consumption and generation where we can see that while there is an obvious trend outliers show that other parameters are also at play. The effect of the peer units behaviour on price shows that as available energy in the peer network increases the total costs also decrease as purchasing energy becomes cheaper. The final plot shows that in these scenarios the battery size has an influence on the quality of results, but at these scales the 25kWh battery provides little advantage over the 5kWh battery.

If we consider all the 74 scenarios, the total cost of running the units is £1720.99 for the naive forecasting, £1652.69 for the SARIMA based forecasting and £1628.04 for the perfect

forecast. This shows that the inclusion of forecasting into control methods and markets on a similar setup has the potential to improve costs by 5.41% in the case of perfect forecasting and can reduce costs by 3.96% even when using simple methods such as ARIMA and SARIMAX. An overview the effects of forecasting on the whole scenario set can be seen in Table II.

When considering the effects of forecasting on the stability of the resulting local grids we consider the .98 quantile values for power supply and demand for each unit as well as their mean voltage and .98 quantile of their V_{RMS} Sag. We use the quantile values instead of the minimum values to filter out peaks in the system and to better understand the overall behaviour. The behaviour of each forecasting method can be seen in Table III, where we can see that while the effect of the forecasting methods is minimal on the Power Demand, its effects are considerable on the Supply and V_{RMS} Sag.

VI. CONCLUSIONS AND FUTURE WORK

We proposed a distributed predictive controller capable of handling coupled constraints which optimises generation costs. These costs are obtained via a negotiation framework based on a MAS; agents corresponding to each network agree upon pricing policies to transact their output power. Both control and market layers are subject to exogenous inputs dictating the interaction of the system with its environment. A rigorous analysis of the properties, existence of game theoretic equilibrium points for the market layer and recursive feasibility for the control layer, was given. The controller is proven to be recursively feasible in presence of time-varying information, both voltages form neighbouring nodes and forecasts. We have developed a testing and evaluation environment to assess the performance of our controller. We explored the effects of varying forecast accuracy in the controller performance and the pricing policies. The proposed system is a scalable solution to the problem of pricing and control.

VII. ACKNOWLEDGEMENTS

This work was supported by the UK Research and Innovation (UKRI) through the Engineering and Physical Sciences

Research Council (EPSRC) as part of the Energy Revolution Research Consortium (ERRC) with the reference EP/S031863/1.

REFERENCES

- [1] D. B. Spence, "Naïve Electricity Markets," in *Energy Markets and Responsive Grids*, S. Meyn, T. Samad, I. A. Hiskens, and J. Stoustrup, Eds., 2018, pp. 29–57.
- [2] H. Farhangi, "The path of the smart grid," *IEEE Power and Energy Magazine*, vol. 8, no. 1, pp. 18–28, jan 2010.
- [3] A. Annaswamy and S. Baros, "A Dynamic Framework for Electricity Markets," in *Energy Markets and Responsive Grids*, S. Meyn, T. Samad, I. Hiskens, and J. Stoustrup, Eds. Springer, 2018, pp. 129–153.
- [4] D. J. Shiltz, S. Baros, M. Cvetkovic, and A. M. Annaswamy, "Integration of Automatic Generation Control and Demand Response via a Dynamic Regulation Market Mechanism," *IEEE Trans. on Control Systems Technology*, vol. 27, no. 2, pp. 631–646, 2019.
- [5] G. Wang, M. Negrete-Pincetic, A. Kowli, E. Shafieepoorfard, S. Meyn, and U. V. Shanbhag, "Dynamic Competitive Equilibria in Electricity Markets," in *Control and Optimization Methods for Electric Smart Grids*. New York, NY: Springer New York, 2012, pp. 35–62.
- [6] O. Dalkilic, A. Eryilmaz, and X. Lin, "Pricing for the Optimal Coordination of Opportunistic Agents," *IEEE Trans. on Control of Network Systems*, vol. 5, no. 3, pp. 833–845, sep 2018.
- [7] A. Y. R. González, M. P. Alonso, F. Lezama, L. Rodríguez, E. M. de Cote, E. F. Morales, L. E. Sucar, and D. D. Crockett, "A competitive and profitable multi-agent autonomous broker for energy markets," *Sustainable Cities and Society*, vol. 49, p. 101590, 2019.
- [8] S. Davarzani, R. Granell, G. A. Taylor, and I. Pisica, "Implementation of a novel multi-agent system for demand response management in low-voltage distribution networks," *Applied Energy*, vol. 253, p. 113516, 2019.
- [9] G. Satheesh Kumar and C. Nagarajan, "Design and implementation of intelligent energy control for tariff management using multi-agent system in smart/micro grid," *Concurrency and Computation: Practice and Experience*, vol. 31, no. 12, p. e4846, 2019.
- [10] W. Tushar, T. K. Saha, C. Yuen, D. Smith, and H. V. Poor, "Peer-to-Peer Trading in Electricity Networks: An Overview," *IEEE Transactions on Smart Grid*, vol. 11, no. 4, pp. 3185–3200, jul 2020.
- [11] M. E. Peck and D. Wagman, "Energy trading for fun and profit buy your neighbor's rooftop solar power or sell your own-it'll all be on a blockchain," *IEEE Spectrum*, vol. 54, no. 10, pp. 56–61, oct 2017.
- [12] Y. Zhou, J. Wu, C. Long, M. Cheng, and C. Zhang, "Performance Evaluation of Peer-to-Peer Energy Sharing Models," *Energy Procedia*, vol. 143, pp. 817–822, 2017.
- [13] F. Dörfler, J. W. Simpson-Porco, and F. Bullo, "Breaking the hierarchy: Distributed control and economic optimality in Microgrids," *IEEE Trans. on Control of Network Systems*, vol. 3, no. 3, pp. 241–253, 2016.
- [14] M. Nassourou, J. Blesa, and V. Puig, "Optimal energy dispatch in a smart micro-grid system using economic model predictive control," *Proceedings of the Institution of Mechanical Engineers, Part I: Journal of Systems and Control Engineering*, p. 095965181878637, 2018.
- [15] Y. Jia, Z. Y. Dong, C. Sun, and G. Chen, "Distributed economic model predictive control for a wind-photovoltaic-battery microgrid power system," *IEEE Trans. on Sustainable Energy*, vol. 11, no. 2, pp. 1089–1099, 2020.
- [16] T. Morstyn, B. Hredzak, and V. G. Agelidis, "Dynamic optimal power flow for DC microgrids with distributed battery energy storage systems," in *2016 IEEE Energy Conversion Congress and Exposition (ECCE)*. IEEE, sep 2016, pp. 1–6.
- [17] T. Faulwasser and A. Engelmann, "Toward economic nmpc for multistage ac optimal power flow," *Optimal Control Applications and Methods*, vol. 41, no. 1, pp. 107–127, 2020.
- [18] T. Faulwasser, A. Engelmann, T. Mühlporf, and V. Hagenmeyer, "Optimal power flow: an introduction to predictive, distributed and stochastic control challenges," *at - Automatisierungstechnik*, vol. 66, no. 7, pp. 573–589, jul 2018.
- [19] T. Morstyn and M. D. McCulloch, "Multiclass Energy Management for Peer-to-Peer Energy Trading Driven by Prosumer Preferences," *IEEE Transactions on Power Systems*, vol. 34, no. 5, pp. 4005–4014, 2019.
- [20] L. Langer, "An Optimal Peer-to-Peer Market Considering Modulating Heat Pumps and Photovoltaic Systems under the German Levy Regime," *Energies*, vol. 13, no. 20, p. 5348, oct 2020.
- [21] I. Aldaouab, M. Daniels, and R. Ordóñez, "MPC for Optimized Energy Exchange between Two Renewable-Energy Prosumers," *Applied Sciences*, vol. 9, no. 18, p. 3709, sep 2019.


TABLE II
OVERVIEW OF THE BENEFITS OF SARIMA AND PERFECT FORECASTING

Forecast Type	Mean Cost Difference	Units Worse Off	Units Better Off	Worst Unit	Best Unit
Naive/SARIMA	0.152	170	277	-4.462	5.152
Naive/Perfect	0.207	147	300	-3.725	5.261

TABLE III
MEAN VALUES OF UNIT SPECIFIC QUANTILES FOR ENERGY SUPPLY, DEMAND AND VOLTAGE

Forecast Type	Mean Power Supply .98 Quantile	Mean Power Demand .98 Quantile	Mean V_{RMS} Sag .98 Quantile	Mean V_{RMS}
Naive	2818.22	1425.09	214.38	218.50
SARIMA	2635.11	1435.49	214.97	218.62
Perfect	2562.41	1420.35	215.11	218.64

- [22] W. Tushar, B. Chai, C. Yuen, D. B. Smith, K. L. Wood, Z. Yang, and H. V. Poor, "Three-Party Energy Management with Distributed Energy Resources in Smart Grid," *IEEE Trans. on Industrial Electronics*, vol. 62, no. 4, pp. 2487–2498, 2015.
- [23] V. Venkatasubramanian, H. Schattler, and J. Zaborszky, "Fast time-varying phasor analysis in the balanced three-phase large electric power system," *IEEE Trans. on Automatic Control*, vol. 40, no. 11, pp. 1975–1982, nov 1995.
- [24] W. Tushar, J. A. Zhang, D. B. Smith, H. V. Poor, and S. Thiébaux, "Prioritizing consumers in smart grid: A game theoretic approach," *IEEE Trans. on Smart Grid*, vol. 5, no. 3, pp. 1429–1438, 2014.
- [25] J. Lee, J. Guo, J. K. Choi, and M. Zukerman, "Distributed energy trading in microgrids: A game-theoretic model and its equilibrium analysis," *IEEE Trans. on Industrial Electronics*, vol. 62, no. 6, pp. 3524–3533, 2015.
- [26] N. Liu, X. Yu, C. Wang, and J. Wang, "Energy Sharing Management for Microgrids with PV Prosumers: A Stackelberg Game Approach," *IEEE Trans. on Industrial Informatics*, vol. 13, no. 3, pp. 1088–1098, 2017.
- [27] T. Fiez, B. Chasnov, and L. Ratliff, "Implicit learning dynamics in stackelberg games: Equilibria characterization, convergence analysis, and empirical study," in *Proceedings of the 37th International Conference on Machine Learning*, ser. Proceedings of Machine Learning Research, vol. 119. PMLR, 13–18 Jul 2020, pp. 3133–3144.
- [28] A. Ehrenmann, "Equilibrium problems with equilibrium constraints and their application to electricity markets," Ph.D. dissertation, University of Cambridge, 2004.
- [29] T. Başar and G. J. Olsder, *Dynamic Noncooperative Game Theory*. Society for Industrial and Applied Mathematics, jan 1998.
- [30] J. F. Bonnans and A. Shapiro, *Perturbation Analysis of Optimization Problems*. New York, NY: Springer New York, 2000.
- [31] P. Baldvieso Monasterios and P. Trodden, "Model Predictive Control of Linear Systems with Preview Information: Feasibility, Stability and Inherent Robustness," *IEEE Trans. on Automatic Control*, pp. 1–1, jul 2018.
- [32] D. Limon, T. Alamo, D. Raimondo, D. Muñoz de la Peña, J. M. Bravo, A. Ferramosca, and E. F. Camacho, "Input-to-State Stability: A Unifying Framework for Robust Model Predictive Control," in *Nonlinear Model Predictive Control*. Springer Berlin Heidelberg, 2009, pp. 1–26.
- [33] G. E. Box and G. M. Jenkins, "Time series analysis: Forecasting and control san francisco," *Calif: Holden-Day*, 1976.
- [34] T. Fang and R. Lahdelma, "Evaluation of a multiple linear regression model and sarima model in forecasting heat demand for district heating system," *Applied energy*, vol. 179, pp. 544–552, 2016.
- [35] R. G. Kavasseri and K. Seetharaman, "Day-ahead wind speed forecasting using f-arima models," *Renewable Energy*, vol. 34, no. 5, pp. 1388–1393, 2009.
- [36] N. Verba, P. R. Baldvieso-Monasterios, E. Morris, G. Konstantopoulos, E. Gaura, and S. McArthur, "Flexible fog computing architecture for smart microgrids," in *15th Conference on Sustainable Development of Energy, Water and Environment Systems*. SDEWES, 2020.
- [37] D. Dua and C. Graff, "UCI machine learning repository," 2017. [Online]. Available: <http://archive.ics.uci.edu/ml/machine-learning-databases/00321/>



Nandor Verba is a research fellow at Coventry University. He received a PhD in the field of Internet of Things from Coventry University, UK for his work on Application Deployment Optimisation in heterogeneous Fog Computing environments. His current work on HEED and EnergyREV focuses on the digital architecture of Energy Systems and achieving their full potential through cyber-physical components with special interest in forecasting, anomaly detection and optimisation.



Euan Morris received the MEng degree (2014) and the PhD degree (2020) from the Department of Electronic and Electrical Engineering at the University of Strathclyde. He is currently a Research Associate at the both the Power Networks Demonstration Centre and with the EnergyREV research consortium with a focus on advanced artificial intelligence applications.



Thomas Morstyn (M'16) received the B.Eng. degree (Hons.) in electrical engineering from the University of Melbourne in 2011, and the Ph.D. degree in electrical engineering from the University of New South Wales in 2016. He is a Lecturer of Power Electronics and Smart Grids with the School of Engineering, University of Edinburgh. He is also an Oxford Martin Associate with the Oxford Martin School, University of Oxford. His research interests include multiagent control and market design for integrating distributed energy resources into power

system operations.



George Konstantopoulos received his Diploma and Ph.D. in Electrical and Computer Engineering from the University of Patras, Greece, in 2008 and 2012, respectively. Since 2013, he has been with the Department of Automatic Control and Systems Engineering, The University of Sheffield, UK, where he is currently a senior Lecturer. His current research interests include nonlinear modelling, control and stability analysis of power converter and electric machine systems with emphasis in microgrid operation, renewable energy systems and motor drives.



Pablo R. Baldvieso-Monasterios is a post-doctoral research associate in the Department of Automatic Control and Systems Engineering, University of Sheffield, UK. He received a Ph.D in robust distributed model predictive control from the University of Sheffield, UK in 2018. He is part of the Energy Revolution consortium (EnergyREV). His research interests include robust and distributed model predictive and optimisation-based control, and game theoretic methods for control and smartgrids.



Elena Gaura is a Professor of Pervasive Computing at Coventry University, UK, researching into Cyber Physical Systems. She works on evidence driven designs for socio-technical complex systems governed by data and specifically through data-to-knowledge pipelines. Over the past few years she lead numerous international programmes supporting the development of science and innovation as well as developing capacity for research world wide and specifically in and with the Global South.



Stephen McArthur is the Distinguished Professor of Intelligent Energy Systems and a Deputy Associate Principal (for Research, Knowledge Exchange and Innovation) at the University of Strathclyde. His main area of expertise is intelligent system applications in energy covering smart grids, condition monitoring and data analytics. Data analytic solutions developed by his team have been deployed for a range of national and international energy companies. As Principal Investigator of the EnergyREV consortium, Stephen is responsible for ensuring that the programme aligns with the needs of PFER and delivers on its objectives and KPIs. His research within EnergyREV targets the use of artificial intelligence to support the smart functionality and interoperability required within smart local energy systems.